



Solar PACES Task III

Thermal Storage

Survey on R&D Activities

Actualization date: 09/2020

Contact person for updating and participation:

Dr. Rocío Bayón: rocio.bayon@ciemat.es

CONTENTS BY KIND OF STORAGE

Sensible heat storage.....	2
Latent heat storage.....	41
Thermochemical storage	55

Prepared by Rocío Bayón (CIEMAT-PSA) with the contribution of the following participants in alphabetic order:

Institution	Country
CEA-LITEN	France
CIEMAT-PSA	Spain
CENER	Spain
DLR	Germany
ENEA	Italy
FRA	Germany
ICP-CSIC	Spain
IEE-CAS	China
IRESN	Morocco
IK4-TEKNIKER	Spain
Masdar Institute	Emirates
SIJ	Germany
SUPSI	Switzerland
TAU	Israel
TECNALIA	Spain
UniZar	Spain

SENSIBLE HEAT STORAGE

CEA – LITEN
(France)



TASK III-TES

Regenerative Storage

Challenges:

- Relatively low storage density,
- Differential dilatation between storage media and envelope=> mechanical stability of design in the case of unstructured solid materials,
- Regenerators are widely used in steel and glass industry, but only a few pilot TES units are tested for CSP applications (in Central Receiver Systems with atmospheric air receivers)

State of the art:

- Regenerators are widely used in steel and glass industry.
- Pilot TES units are currently tested in power towers with atmospheric air receivers.

Concept approach:

Low cost and robust regenerators:

- covering a very large range of temperature levels (particularly interesting for high temperature values),
- using low cost natural materials (rock) or efficient ceramics.

Current R&D status:

- An experimental device (*CLAIRE*) has been built and tested with air as heat transfer fluid:
 - two test sections volumes (1.2 x 1.2 x 5 m) working at temperatures between 600 and 1300 °C
 - Tests have been made with gravels and structured ceramics at 800°C
 - Dynamic thermo-aerualics models have been developed for sizing purposes.
 - Three dimensional CFD simulations have been validated on experimental results.

Further information:

Contact persons: Jean François Fourmigué (jean-francois.fourmigue@cea.fr) and Pierre García (pierre.garcia@cea.fr)

Publications:

- Desrues, T., Ruer, J., Marty, P., Fourmigué, J.F. A thermal energy storage process for large scale electric applications (2010). Applied Thermal Engineering, 30 (5), pp. 425-432
- Reboussin, Y., Fourmigué, J.F., Marty, Ph., Citti, O. A numerical approach for the study of glass furnace regenerators (2005). Applied Thermal Engineering, 25 (14-15), pp. 2299-2320.
- Esence, T., Bruch, A., Molina, S., Stutz, B., Fourmigué, J.F., A review on experience feedback and numerical modeling of packed-bed thermal energy storage systems, Solar Energy 153 (2017) 628–654.

Future work:

- Validation of simulations, dynamic 1D models or CFD, has to be improved.
- A 250 kWh demonstration unit has been built and connected to the Alsolen450 demonstrator, it is currently under testing.
 - Temperature range from 300 °C to 450 °C
 - Horizontal brick regenerator powered by reversible fans,
 - Integrated in a CSP Fresnel power plant demonstrator.

CEA – LITEN
(France)



Heat storage with dual media thermocline

Challenges:

- NREL at Solar Paces 2010: “Thermocline is uncontrollable and unpredictable”, making such system inefficient and unusable;
- Very limited experimental data available in the literature and few dual media thermocline installations built up to now. In addition, most of the experimental data show scattering and was obtained in limited range of operating parameters;
- Construction of a dual media thermocline at commercial CSP plant size. Up to now, only one industrial dual-media thermocline has been built (Solar One solar tower);
- Interaction between storage material and thermal fluid.

State of the art:

- No systematic study of the influence of operating parameters and control strategy.

Concept approach:

Low cost and robust heat storage dual media thermocline characterized by:

- non pressurized thermal oil as thermal fluid;
- no expansive natural rock as storage material;
- additional porosity reduction by using multiple rock sizes;
- possible oil/rock interaction leading to rock and/or oil degradation.

Current R&D status:

- A prototype-scale ($STONE \approx 3 \text{ m}^3$) thermocline is successfully operated
 - Highly controllable and predictable operation at different oil velocities,
 - Fine understanding of the hydraulic and thermal behaviors,
 - Compared with results from other experimental facilities (CNRS-PROMES).
- A demonstrator-scale ($\approx 30 \text{ m}^3$) thermocline is successfully operated
 - Integrated in a CSP Fresnel power plant prototype,
 - Allows validating the behavior, the control and the performances of a dual thermocline storage unit in real operating conditions.
- Our numerical model shows good agreement with the experimental data and can be used for thermocline size extrapolation with good confidence level, for performance predictions and for the definition of operating strategies of commercial CSP plants.

Further information:

Contact person: Arnaud Bruch (arnaud.bruch@cea.fr)

Publications:

- Bruch, A., Fourmigue, J.F., Couturier, R., Experimental and numerical investigation of a pilot-scale thermal oil packed bed thermal storage system for CSP power plant, *Solar Energy* 105 (2014) 116–125.
- Esence, T., Bayón, R., Bruch, A., Rojas, E., Study of thermocline development inside a dual-media storage tank at the beginning of dynamic processes, *AIP Conference Proceedings*, 1850, 080009 (2017).
- Bruch, A., Molina, S., Esence, T., Fourmigué, J.F., Couturier, R., Experimental investigation of cycling behaviour of pilot-scale thermal oil packed-bed thermal storage system. *Renewable Energy* 103, 277-285 (2017).
- Gibbs, A., Robinson B.W., Rougé, S., Jouhara H, Asaduzzaman, A.K.M., Chowdhury, M., Kjellgren, P., Mezquita Martí, A., Taddei, P, Pardelli, Ciuffi, N., Heat Recovery at High Temperature by Molten Salts for High Temperature Processing Industries, Part 1 & 2, *ATI Conference*, Florence (2019).

Future work:

- Optimization of thermocline control strategy for efficient integration in a CSP plant.
- Test of different storage material and filling procedures.

CENER
(Spain)



CENER
AD|tech

CENTRO NACIONAL DE
ENERGÍAS RENOVABLES



TASK III-TES

Transient simulation of TES systems

Challenges:

Due to the fluctuating nature of solar energy, solar thermal power plants often operate under transient conditions. Thus, whenever TES is applied in these plants, also the storage system is subjected to transients. In many cases, the thermal inertia of the TES system limits the operation strategy of the whole plant, e.g. so that a short cloud pass cannot be balanced by the storage system, since it would take too long to switch from charging to discharging operation. Hence, when optimizing operation strategies the transient response of the TES system must be known, in special when innovative TES systems as thermocline tanks are employed.

State of the art:

So far, most modelling procedures focus on quasi-steady models where transient responses cannot be reproduced and the behavior of innovative TES system integrated in CSP plants are not far studied.

Concept approach:

At the Solar Thermal Energy Department at CENER a very flexible Modelica model library is being developed, which allows the detailed transient analysis of single plant components as well as of the whole solar thermal power plant on system level. This allows the simulation of operating strategies and control loops that are very close to reality and optimize them for innovative TES systems.

Current R&D status:

Currently, the library includes detailed TES models of:

- the conventional active-indirect two-tank type,
- the conventional active direct two-tank type,
- packed-bed thermocline type,
- as well as passive sensible and latent TES type.

Furthermore, these models can be simulated in a full power plant model on system level. . As example, a model of a full CSP plant based on thermocline tank has been developed in the context of the H2020 RESLAG project.

Further information:

Contact person: Dr. Fritz Zaversky (fzaversky@cener.com)

Publications:

- F. Zaversky, Object-oriented modeling for the transient performance simulation of solar thermal power plants using parabolic trough collectors - A review and proposal of modeling approaches for thermal energy storage, PhD Thesis, Public University of Navarre, Pamplona, Spain, 2014 ([http://academica-unavarra.es/handle/2454/16705](http://academica.unavarra.es/handle/2454/16705))
- F. Zaversky, M. Sánchez, D. Astrain, Object-oriented modeling for the transient response simulation of multi-pass shell-and-tube heat exchangers as applied in active indirect thermal energy storage systems for concentrated solar power, *Energy*, 65 (2014) 647-664
- I. Hernández Arriaga, F. Zaversky, D. Astrain, Object-oriented Modeling of Molten-salt-based Thermocline Thermal Energy Storage for the Transient Performance Simulation of Solar Thermal Power Plants, *Energy Procedia*, 69 (2015) 879-890
- Javier López Sanz, Francisco Cabello Nuñez and Fritz Zaversky (2019). "Benchmarking analysis of a novel thermocline hybrid thermal energy storage system using steelmaking slag pebbles as packed-bed filler material for central receiver applications". *Solar Energy* 188C(2019) pp. 644-654

Future work:

- Application of the developed models to improve and optimize operation strategies in more scenarios and applied to different innovative TES systems.

CENER
(Spain)



CENER | CENTRO NACIONAL DE
ENERGÍAS RENOVABLES
ADItch



TASK III-TES

Techno-economic simulation and optimization of innovative TES for air CSP plants

Challenges:

Dispatchability is a key advantage of the CSP plants. However, in the case of using air as HTF, mainly to difficulties related to the heat transfer, it is difficult to find competitive systems. In order to analyze the feasibility of innovative TES systems is important to consider not only technical simulations under transient behavior but also economic data to establish a robust comparison in terms of competitiveness.

State of the art:

There are scientific publications of suitable TES systems in applications based on air as HTF but there are very few information about economic simulations and robust comparison between TES systems in terms of both cost and performance.

Concept approach:

At the Solar Thermal Energy Department at CENER the very flexible Modelica model library is continuously being expanded, allowing not only the detailed transient analysis but also include economic modelling for simulate and estimate economic figures of merits as LCOE for innovative TES systems integrated in CSP plants. At the same time, models of innovative TES can be validated in CENER's thermal loop () able to test sensible and latent materials in a small packed-bed. This allows establishing comparison between different technologies of storage and plant configurations.

Current R&D status:

Currently, the library includes detailed TES models, including transient performance and economic data of:

- Flexible packed-bed thermocline type storage including wide-range of filler materials,
- Hybrid TES storage based on the combination of latent and sensible heat storage (*).

Innovative air CSP plant configurations that include different TES systems and materials are under analysis using this library.

Further information:

Contact person: Francisco Cabello (fcabello@cener.com)

Publications:

- F. Cabello and F. Zaversky, "Comparison of Promising Materials for Filling Thermocline Tanks as Thermal Energy Storage of a CSP Plant Applying Air as HTF". SolarPACES Conference, 29 September-2 October, Albuquerque, New Mexico, USA
- F. Zaversky, F. Cabello, A. Bernardos, M. Sanchez. "A Novel High-Efficiency Solar Thermal Power Plant Featuring Electricity Storage - Ideal for the Future Power Grid with High Shares of Renewables". SolarPACES Conference, 29 September-2 October, Albuquerque, New Mexico, USA

Future work:

- Testing in CENER's thermal loop of the most promising TES materials and analysis via simulation of innovative TES systems in different air CSP plants and applications.
- Development of thermo-chemical storage models for thermal and economic performance simulations.

CIEMAT-PSA (Spain)



TASK III-TES

Simulation of thermocline tanks

Challenges:

- Describe thermocline tank behavior by means of an analytical function that provides outlet temperature with time so that it can be easily implemented in the annual simulations of a CSP plant

State of the art:

- Thermocline tank behavior mainly described by numerical models: 1D, 2D, 3D, CFD calculations models.
- Only some examples of analytical models are found in the literature
- Not many experimental results for thermocline tanks meant to be used in CSP plants
- Validation of the models still required

Concept approach:

- Thermocline tank performance should be described by a simple but accurate enough model
- Single-phase one dimensional model: effective storage medium formed by either a liquid or both a liquid and a solid filler.
- First stage: numerical model
- Second stage: analytical model
- Third stage: CSP plant implementation

Current R&D status:

- Improvement of the model previously developed by using experimental data from thermocline tanks with/without solid filler
- Analytical model based on sigmoid functions
- Correlation between function parameters, tank parameters and operating conditions
- Prediction of thermocline formation at the beginning of dynamic processes of charge and discharge

Further information:

Contact person: Rocío Bayón (rocio.bayon@ciemat.es)

Publications:

- Bayón, R., Rojas, E. Prediction of Thermocline Zone Development at the Beginning of Dynamic Processes in Single Storage Tanks with Liquid Media, SolarPACES 2019. Daegu, South Korea, Oct 2019. Oral
- Bayón, R., Rojas, E. Analysis of Packed-Bed Thermocline Storage Tank Performance by Means of a New Analytical Function. SolarPACES 2017. Santiago de Chile, Chile, sept. 2017. Poster.
- Esence T., Bayón R., Bruch A., Rojas E. Study of Thermocline Development Inside a Dual-media Storage Tank at the Beginning of Dynamic Processes, AIP Conference Proceedings, 1850, 080009 (2017).
- Bayón R., Rojas E.: Analytical function describing the behavior of a thermocline storage tank: a requirement for annual simulations of solar thermal power plants. International Journal of Heat and Mass Transfer 68 (2014) 641-648.
- Bayón R., Rojas E.: Simulation of thermocline storage for solar thermal power plants: From dimensionless results to prototypes and real-size tanks. International Journal of Heat and Mass Transfer 60 (2013) 713-721.
- Bayón R., Rivas E., Rojas E.: Study of thermocline tank performance in dynamic processes and stand-by periods with an analytical function, SolarPACES 2013. Las Vegas (USA), September 2013. Oral presentation.

Future work:

- Model validation with experimental data from thermocline tanks with/without filler.

CIEMAT-PSA (Spain)



TASK III-TES

ALTAYR installation

Challenges:


- Experimentally study of air-solid thermocline tanks behavior: effect of operational conditions, physical parameters estimation, operative limits and thresholds. Validation of numerical models for industrial tanks performance prediction and facilitation of reliable designs.

State of the art:

- Few experimental facilities for air-solid thermocline tanks.
- Different approaches for simulations of air-solid thermocline with high complexity and limited validity. Not all the models are validated.
- No agreement on the contribution grade of physical mechanism present in an air-solid high temperature thermocline.

Description:

- Cylindrical tank with a bed height of 0.5 m (tank height 0.72 m) and 0.5 m in inner diameter.
- Metal casing + insulation layer + ceramic inner wall. Two additional conical bodies on and under the cylinder.
- Hot air heated by electrical resistances.
- Charge mode: inlet through the top and outlet through the bottom. Discharge mode: inlet through the bottom and outlet through the top.
- Set point temperature from ambient to more than 1000 °C
- Thermocouples in the bed at 9 different heights and 4 radiuses, on the outer wall of the tank at 10 heights and 5 angular positions and in the air inlet and outlet

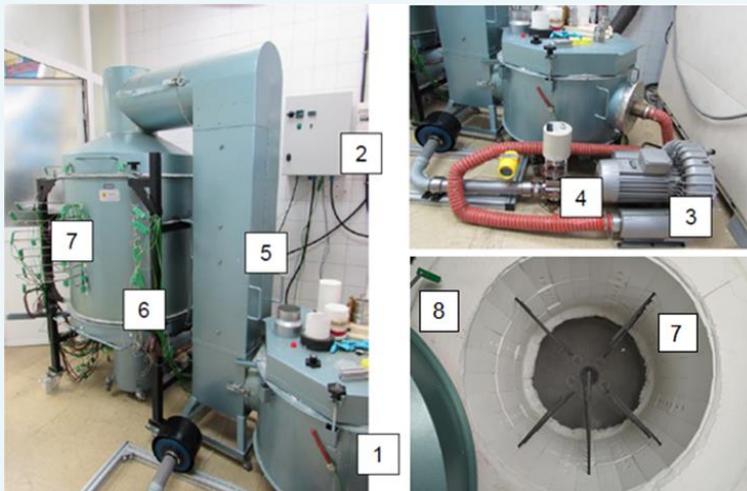

Pictures of different views of ALTAYR experimental facility:

1. Electric resistances.
2. Resistances control board.
3. Blower.
4. Flowmeter.
5. Hot air inlet tube.
6. External wall thermocouples.
7. Inner thermocouples.
8. Inside of the storage tank

Applications:

- Thermal storage in the form of sensible heat for concentrating solar power, other renewables, waste heat recovery, or any process which requires heat storage at high temperature.

Further information:

Contact person: Elisa Alonso Romero (elisa.alonso@ciemat.es)

Publications:

- Alonso, E., Rojas, E., Bayón, R. Packed-bed Thermocline Testing Facility with Air as HTF for Sensible Thermal Energy Storage. Eurosun 2020. Online, Sept 2020. Oral
- Alonso, E., Rojas, E., Bayón, R. Experimental and Numerical Study of an Air-Solid Thermocline Thermal Energy Storage System Operating at High Temperature. SolarPACES 2020. Online, Sep-Oct 2020. Oral

**CIEMAT-PSA
(Spain)**



Ciemat
Centro de Investigaciones
Energéticas, Medioambientales
y Tecnológicas



TASK III-TES

Molten Salt Test Loop for Thermal Energy Storage (MOSA)

Challenges:

- Reliability of components used in molten salt loops under CSP conditions
- Optimization of different operation procedures for CSP storage systems based on molten salts

State of the art:

- This test loop is a replica of a two-tank thermal storage system with molten salts

Description:

- Vertical hot tank and horizontal cold tank with 40t of molten salt inventory
- A thermal oil loop that can be used for either salt heating up to 380°C or cooling down to 290°C.
- Two flanged sections where different components for this type of loops (e.g. valves, flow meters, heat trace, pumps...) can be tested
- Being a down-scaled facility of a commercial two-tank molten salt storage system everything related to this type of systems can be tested in a more simple way



Applications:

- Test of different components (pumps, valves, flowmeters, etc.) for their use in a molten salt medium
- Optimization of operation procedures under both normal and risky situations for a two-tank system configuration
- Designing recovery procedures
- Validation of models and simulation approaches for molten salt storage systems
- Characterization of molten salt/oil heat exchanger
- Characterization of thermozone tanks.

Further information:

Contact person: Margarita Rodríguez (margarita.rodriguez@psa.es)

Publications:

- M. M. Rodríguez-García, E. Zarza, "Design and Construction of an Experimental Molten Salt Test Loop", 17th International SolarPACES Conference, Granada (Spain), September 2011.
- M.M. Rodríguez-García, M. Herrador Moreno, E. Zarza Moya, Lessons learnt during the design, construction and start-up phases of a molten salt testing facility, Applied Thermal Engineering, Vol. 62, Issue 2, Pages 520-528, ISSN 1359-4311, <http://dx.doi.org/10.1016/j.applthermaleng.2013.09.040>.
- J. Bonilla, M.M. Rodríguez-García, L. Roca, L. Valenzuela, Object oriented modeling of a multi-pass shell-and-tube heat exchanger and its application to performance evaluation, IFAC-Papers online, Vol. 48, Issue 11, 2015, Pag. 97-102, ISSN 1876-6102, <http://doi:10.1016/j.ifacol.2015.09.166>
- L. Roca, J. Bonilla, M.M. Rodríguez-García, P. Palenzuela, A. de la Calle, L. Valenzuela, Control strategies in a thermal oil-molten salt heat exchanger, AIP Conference proceedings 1734, 130017 (2016), <http://doi:10.1063/1.4949227>

**CIEMAT-PSA
(Spain)**



TASK III-TES

Test benches with molten salts (BES-I & BES-II)

Challenges:

- Validation and testing of components used in molten salt installations.

State of the art:

- These loops are intended for performing validation test for conventional components used in molten salt circuits in a simple and quick way

Description:

- Two test benches, BES-I and BES-II, are especially designed for testing of valves, pressure transmitters and other molten salts components under real working conditions up to 600°C and 40 bar. Components with nominal diameters from 2" up to 6" can be evaluated in these test benches.

Applications:

- Tests for different types of valves
 1. Leakage test
 2. Validity for design conditions test
 3. Cold zone test
 4. Packing life test
- Tests for pressure transmitters
 1. Constant pressure test
 2. Pressure variation test
- Validation of other components and auxiliary equipment like heat tracing, insulation, etc.



Further information:

Contact person: Margarita Rodríguez (margarita.rodriguez@psa.es)

Publications:

- M-M. Rodríguez-García, E. Rojas, M. Pérez, Procedures for testing valves and pressure transducers with molten salt, Applied Thermal Engineering, Volume 101, 25 May 2016, Pages 139-146, ISSN 1359-4311, <http://dx.doi.org/10.1016/j.applthermaleng.2016.02.138>.
- M.M. Rodríguez-García, A. López-Tamayo, E. Rojas, Components test device with molten salt at high temperature and pressure. 20th International SolarPACES Conference, Beijing (China), September 2014.

**DLR: German
Aerospace Center
(Germany)**



MOLTEN SALT STORAGE

Challenges for Materials:

- Qualification of suitable mixtures for direct molten salt parabolic trough technology
- Qualification of molten salt mixtures with higher operation temperature (chloride and nitrate)
- Metallic corrosion including impact of salt chemistry
- Compatibility of non-metal materials with molten salt (e.g. filler, seals)
- Fundamental understanding of molten salt mixtures (e.g. prediction of mixture behavior)

Challenges for Components:

- Improvement of reliability and capital cost of two-tank systems
- Capital cost reduction of the two-tank system by alternative single tank systems
- Improvement and reliability of power related components (e.g. heaters, heat exchangers)
- Improvement and reliability of additional molten salt components (e.g. instrumentation, valves, pumps, piping, auxiliary heating)
- Fundamental process technology aspects (e.g. salt freezing, heat transfer, dynamic operation)

Challenges for Systems:

- Assessment of the theoretical potential and experimental proof of novel configurations with molten salt storage (e.g. direct molten salt trough, Fresnel, supercritical steam, supercritical CO₂, alternative salts with higher operation temperature, topping cycles, hybrid CSP plants with PV)
- Assessment of single tank thermocline concepts in overall CSP configurations

State of the art:

- The two-tank molten salt storage is commercially available as standard solution.

Concept approach:

- Physicochemical and thermophysical molten salt examinations including liquid-gas interaction and liquid-solid interaction (e.g. corrosion) with three labs (autoclave, thermal analysis, wet chemistry)
- Alternative single tank thermocline design to reduce costs with TESIS:store facility (4 MWh_{th} scale)
- Qualification of molten salt components with TESIS:com facility (e.g. heat exchanger, valves, instrumentation, absorber tubes)
- System analysis and dynamic simulation for molten salt storage integration (e.g. thermocline)

Current R&D status:

- Several DLR and third party funded projects on material, component and system levels.
- Operation of 560 °C Test Facility for Thermal Energy Storage in Molten Salt (TESIS) since 2018

Further information:

Contact person: Thomas Bauer (thomas.bauer@dlr.de)

- Homepage including a link to recent literature and further information:
https://www.dlr.de/tt/en/desktopdefault.aspx/tabid-11483/7874_read-12367/
- TESIS: https://www.dlr.de/tt/en/desktopdefault.aspx/tabid-13758/23900_read-56896/

ENEA
(Italy)

ENEA
Agenzia nazionale per le nuove tecnologie,
l'energia e lo sviluppo economico sostenibile



TASK III-TES

Innovative concept of a thermal energy storage system based on a single tank configuration using stratifying molten salts

Challenges:

- Assessment of a TES-SG (Thermal Energy Storage- (integrated) Steam Generator) system based on a single tank containing a thermal storage liquid material (HSM: heat storage material)
- Store energy (during the charging phase) as sensible heat, and, during thermal discharging, transfer the energy to another fluid by a heat exchanger immersed into the HSM bulk.
- Maintain a vertical thermal stratification profile in the HSM fluid (thermocline), due to the layers difference of density with temperature

State of the art:

- Two tanks based systems (a hot and a cold one) are currently employed as TES systems, in particular coupled with parabolic trough solar (PCS) plants
- ENEA (along with Ansaldo) developed an international patent about the possibility to employ a more compact integrated TES system consisting of a unique storage tank and an immersed SG.


Concept approach:

Thermal energy storage system based on a single tank with an integrated heat exchanger:


- lower costs for heat storage
- higher possibilities for TES systems modularity
- lower cost for the steam generator

Current R&D status:

- Several experimental results have been collected in the operation of the PCS facility located at the ENEA Casaccia centre
- Molten nitrate ($\text{NaNO}_3/\text{KNO}_3$ 60/40 wt%) stratification behaviour has been confirmed and investigated
- The experimental work has shown that the thermal stratification can be maintained quite constant for several hours and the presence of the integrated steam generator actively guarantees and maintains the stratification during the operation time, avoiding mixing of the stratified layers

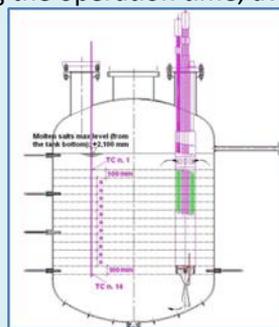

Scheme of the experimental set-up

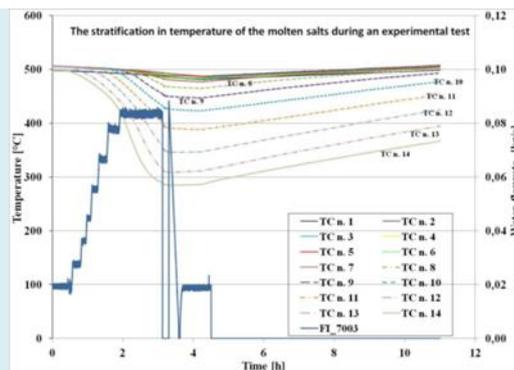

Trends of MS temperatures and water flow rate during an experimental test

Further information:

Contact person: Ing. Walter Gaggioli, ENEA UTRINN/STD, (walter.gaggioli@enea.it)

Associated funded projects:

- OPTS (OPTimization of a Thermal energy Storage system with integrated Steam Generator), CP-FP7

Publications:

- Gaggioli et. Al – “An innovative concept of a thermal energy storage system based on a single tank configuration using stratifying molten salts as both heat storage medium and heat transfer fluid, and with an integrated steam generator” – Solar Paces (2013) - Energy Procedia 00 (2013) 000–000

Future work:

- Optimization of charging/discharging cycles for the TES-SG system, and upgrading of the experimental apparatus equipment
- Study on tank and SG new feasible materials, with the aim of further decreasing thermal storage investment costs
- Investigation on the possibility of using solid filler materials coupled with the molten nitrates, in order to decrease the HSM (heat storage materials) costs.

ENEA
(Italy)

ENEA
Agenzia nazionale per le nuove tecnologie,
l'energia e lo sviluppo economico sostenibile



TASK III-TES

Employment of low melting nitrate/nitrite mixtures as HTF and HSM

Challenges:

- Decrease the HTF (heat transfer fluid) initial solidification point, with the main target to improve management and maintenance operation of a solar plant
- Design of a more economical thermal energy storage system for plants where thermal oil is employed as HTF, and where the maximum operating temperature is around 400 °C
- Definition of the operational characteristics for the integration of these HTF/HSM in the currently used solar energy technology
- Development of thermodynamics predictive models for the mixture phase diagrams

State of the art:

- Nitrate/nitrite based low melting mixture has been widely investigated in the recent scientific literature. Some of these mixture compositions have been patented
- For some of these mixtures the value of the maximum allowed operating temperature is not clearly established. Actually, an agreement upon common measurements criteria is also to be reached
- A few ternary/quaternary phase diagrams are already present in the scientific literature and some

thermodynamics models are proposed.

Concept approach:

- Employment of low melting materials as HTF/HSM (<100-140 °C of initial solidification temperature) as an alternative solution for an alkaline nitrate mixture where a lower maximum temperature is to be used. A lower temperature can allow the employment of less costly CSP construction materials (e.g. “carbon steels”)
- • Use of less costly alternative for thermal oils
- • Decrease the thermal storage components material costs
- • Adoption of less costly maintenance operations

Current R&D status:

- Validation of thermo-physical properties
- An experimental campaign through a dedicated set-up to investigate the chemical stability properties of thermal fluids has been concluded
- Modeling activity is ongoing, and main results have been published especially within the Solar Paces conference

Further information:

Contact person: Dr. Salvatore Sau, ENEA DTE STT ITES; (salvatore.sau@enea.it)

Publications:

- Sau, S., Corsaro, N., Crescenzi, T., D'Ottavi, C., Liberatore, R., Licocchia, S., Russo, V., Tarquini, P., Tizzoni, A.C. Techno-economic comparison between CSP plants presenting two different heat transfer fluids (2016) Applied Energy, 168, pp. 96-109
- Tizzoni, A.C., Sau, S., Corsaro, N., Giaconia, A., D'Ottavi, C., Licocchia, S. Thermal fluids for CSP systems: Alkaline nitrates/nitrites thermodynamics modelling method (2016) AIP Conference Proceedings, 1734
- Bonk A., Sau S., Uranga N., Hernaiz M., Bauer T.: Advanced heat transfer fluids for direct molten salt line-focusing CSP plants. Progress in Energy and Combustion Science; accepted for publication, 67, pp. 69-87
- Delise, T., Tizzoni, A.C., Ferrara, M., Corsaro, N., D'Ottavi, C., Giaconia, A., Turchetti, L., Annesini, M.C., Telling, M., Sau, S., Licocchia, S.; New solid phase of KNO₃- NaNO₃ salt mixtures studied by neutron scattering and differential scanning calorimetry analysis (2018) AIP Conference Proceedings, 2033, art. no. 080001
- Delise, T., Ferrara, M., Turchetti, L., Tizzoni, A., Telling, M., D'Ottavi, C., Corsaro, N., Sau, S., Licocchia, S.; Thermo-physical investigation of low melting HFT and HSM containing calcium nitrate (2019) AIP Conference Proceedings, 2126, art. no. 080001

Associated Funded Projects:

- SFERA II (Solar Facilities for the European Research Area II);
- STAGE-STE (Scientific and Technological Alliance for Guaranteeing the European Excellence in Concentrating Solar Thermal Energy)
- SFERA III (Solar Facilities for the European Research Area III)
- National program funded by the Italian Ministry for Economic Development (MISE): “Piano Triennale Ricerca di Sistema 2019-2021”

Future work:

- Thermal stability analysis on low melting mixtures carried out by a dedicated experimental set-up developed during the SFERA II project. This equipment has been proposed to be available in the contest of future transnational access activities.

- Compatibility study between low melting mixtures and (possibly economical) materials feasible to be used for the construction of thermal storage components (tank, SG). At this aim, besides tests in static conditions, a dedicated experimental set-up is being designed and constructed (funded within SFERA III CP) to test material resilience with thermal fluids, especially below 500°C, in dynamic (meaning, under molten salts flow) conditions.
- Simulation thermodynamic models with the aim to develop predictive tools for new low melting mixtures.
- The experimental and modeling campaign to complete the knowledge about ternary/multicomponent phase diagrams is ongoing. The thermodynamics models proposed in the scientific literature are being and will be applied, validated and, where necessary, improved.

ENEA
(Italy)

ENEA
Agenzia nazionale per le nuove tecnologie,
l'energia e lo sviluppo economico sostenibile



TASK III-TES

Innovative concept of a thermal energy storage system based on a single tank configuration using stratifying low melting molten salts

Challenges:

- Thermal energy storage for CSP plants coupled with ORC turbine
- Design of a thermal energy storage element
- Definition of the operational characteristics for the integration of the storage system into the solar plant
- Balancing of the power energy flows in the local Medium Voltage grids

State of the art:

- Development of a software tool for simulating the solar heat charge and discharge
- A prototype system equipped with a pump and two integrated exchangers have been realized; it uses mineral oil as HTF and a mixture of salts as HSM, consisting of NaNO₃, KNO₃ and Nitcal (KNO₃; 5Ca(NO₃)₂). (TRL4).



Scheme of the coupling CSP-TES-ORC and image of the prototype system installed at ENEA Casaccia Research Centre (Rome)

Concept approach:

- This kind of TES is based on the thermocline technology which uses low melting point salt as heat storage medium by exploiting the natural stratification of the molten salts with temperature. It is an indirect TES with molten salts inside the tank and HTF flowing into two heat exchangers (HXs) as well as an impeller, inside the discharge pipe, to allow a forced circulation

Current R&D status:

- A Thermo-fluid - dynamic model has been developed to simulate the behaviour of TES system coupled with a real CSP plant during the different operative conditions
- An experimental campaign of charge and discharge tests to characterize the behaviour of the new TES system in real working conditions was performed during 2018

Further information:Contact persons:

- Walter Gaggioli, PhD, Solar Thermal Division, (walter.gaggioli@enea.it)
- Raffaele Liberatore, Solar Thermal Division, (raffaele.liberatore@enea.it)

Publications:

- J.M. Rodríguez, D. Sánchez, G.S. Martínez, E.G. Bennouna, B. Ikken, Techno-economic assessment of thermal energy storage solutions for a 1 MWe CSP-ORC power plant, Solar Energy 140 (2016) 206-218.
- V. Russo, D. Mazzei, R. Liberatore, Thermal Energy Storage With Integrated Heat Exchangers Using Stratified Molten Salt System For 1 MWe CSP. AIP Conference Proceedings. Volume 2033, 8 November 2018, Article number 090025
- Liberatore R, Falchetta M, Gaggioli W, Mazzei D, Russo V. power production of an ORC System using a stratified molten salt as thermal energy storage integrated in a CSP plant. Proceeding of Solar Paces 2018, Casablanca, 2-5 October.

Associated Fundend Project:

- European Commission's Horizon2020 Programme (Innovation and Networks Executive Agency - ENERGY RESEARCH) - Innovation Action nr. 657690.
- National program funded by the Italian Ministry for Economic Development (MISE): "Piano Triennale Ricerca di Sistema 2019-2021"

Future work:

- A new lay out of storage module provided with a layer of phase change material (PCM) will be tested with the goal to stabilize the temperature on the top of the tank during the TES charge and discharge operations.

ENEA
(Italy)

ENEA
Agenzia nazionale per le nuove tecnologie,
l'energia e lo sviluppo economico sostenibile

SolarPACES
TASK III-TES

Packed-bed thermocline TES system using molten salts as heat transfer fluid**Challenges:**

- To increase the cost effectiveness of sensible heat storage system by using a single tank instead of two, in order to save costs associated with the construction of the tank
- To significantly reduce the amount of molten salts required as heat storage material in sensible heat TES systems, by replacing them with an inexpensive solid material
- To promote industrial symbiosis by re-using processed industrial waste as heat storage material for CSP plants in a circular economy perspective

State of the art:


- Packed-bed thermocline TES systems are object of a significant interest worldwide and numerous modeling works are available in the literature
- In general, there is a lack of experimental data collected on significant-scale systems for the validation of mathematical models.
 - A small number of pilot-scale systems are today available worldwide and, among these, only few use molten salts as heat transfer fluid.

Concept approach:

- Packed-bed thermocline systems are sensible-heat TES systems, which exploit the presence of an axial temperature gradient to store the hot and cold heat storage medium (HSM) within a single tank. The HSM consists in part in a packed-bed of inert and inexpensive solid, through which the heat transfer fluid (HTF) is flown
- Solar salt (60% NaNO₃, 40% KNO₃) is used as HTF, so that the system is suitable to be included in CSP plants using this HTF (e.g., molten salt towers)
- The packed-bed is made of pebbles produced by processing and sintering steel slags, a waste of the steel-making process

Current R&D status:

- The commissioning of a pilot packed-bed TES system (see figure below) has been completed in August 2019. The pilot plant is integrated into the molten salt circuit of the existing ENEA's PCS facility, located at ENEA Casaccia Research Center (Rome, Italy). The main component of the pilot plant is the test section (TS), a mock up TES unit, in which the thermo-fluid dynamic conditions of a full-scale packed bed TES system are reproduced. The TS is a cylindrical column with vertical filling, suitably modified for the research purposes, containing the fixed bed (1 m diameter, 3 m height) of slag pebbles and other internals (TRL4).

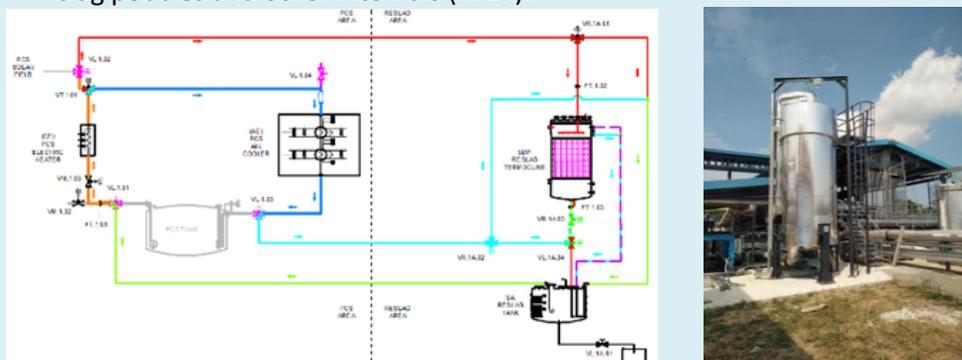

Scheme of packed bed TES prototype system installed at ENEA Casaccia Research Centre Rome Italy

- A first experimental campaign on the pilot is ongoing
- A Thermo-fluid - dynamic model has been developed to simulate the behavior of the TES system during the different operating phases

Further information:Contact person:

- Walter Gaggioli, PhD, Solar Thermal Division, (walter.gaggioli@enea.it)
- Luca turchetti, PhD, Solar Thermal Division, (luca.turchetti@enea.it)

Associated Funded Project:

- European Commission's Horizon2020 Programme: RESLAG project Grant Agreement n. 642067

Future work:

- The pilot plant is included within the list of European facilities available for transnational access in the framework of the H2020 European Project SFERA III (G.A n. 823802). In this context, an experimental campaign will be carried out in collaboration with CENER, to further characterize the TES system behavior..

Fraunhofer ISE
(Germany)



TASK III-TES

Thermal storage in a single thermocline tank

Challenges:

- Single-tank molten salt storage concepts promise cost reduction compared to the state-of-the-art two-tank storage system but may have lower efficiency due to mixing processes
- Lack of experimental data for single-tank systems to assess the actual performance prevent the commercial application of single-tank storage systems

State of the art:

- Two-tank storage system where cold and hot fluid are separated in individual tanks

Concept approach:

- Design, construction and testing of a molten salt single-tank prototype
- Parameter identification for numerical models to improve the accuracy of simulations
- Small test facility allows for versatile operating conditions (flow rate and heat loss) but area to volume ratio is worse than for large-scale tank



Current R&D status:

- During many charging/discharging cycles with different parameters a good stratification of the storage could be established and a relatively thin thermocline zone being observed what indicates a high storage efficiency

Further information:

Contact person: Tom Fluri (tom.fluri@ise.fraunhofer.de)

Publications:

- B. Seubert, R. Müller, D. Willert, T. Fluri: Experimental results from Laboratory-Scale Molten Salt Thermocline Storage. SolarPaces, Abu Dhabi, 2016.
- M. Karl, B. Seubert, R. Müller, T. Fluri, P. Nitz: Experimental Performance Evaluation of a Laboratory-Scale Molten Salt Thermocline Storage, Proceedings of the 23th SolarPACES, Santiago, Chile, 2017

Future work:

- Modifying of the molten salt single-tank prototype towards a system with innovative fillers
- Running of consecutive charging/discharging cycles to identify long term development of thermocline

Fraunhofer ISE
(Germany)



Thermocline Tank Simulation

Challenges:

- Single-tank molten salt storage concepts promise cost reduction compared to the state-of-the-art two-tank storage system but may have lower efficiency due to mixing processes
- Modelling of the mixing processes is either neglected in simple 1D-models or tremendous effort in CFD simulations

State of the art:

- 1D models with first-order methods for the convective fluxes introduce numerical diffusion which can be interpreted as mixing but is only a numerical effect
- Mixing is not a function of the charging velocity or temperature difference
- System integration of alternative storage concepts is often neglected

Concept approach:

- Development of a storage model with higher-order schemes which is not susceptible to numerical effects but still allows for fast simulations
- Implementation of a mixing factor that considers inlet flow rate and temperature difference
- Integration of the model into the system simulation program ColSim CSP to perform annual simulations and evaluate storage performance in system context for e.g. the ORC-PLUS project

Current R&D status:

- Alternative algorithms for the implementation of mixing
- Integration of the option to insert filler materials into storage

Further information:

Contact person: Tom Fluri (tom.fluri@ise.fraunhofer.de)

Publications:

- B. Seubert, T. Fluri and W. Platzer: Numerical investigation of a high temperature stratified storage with integrated steam generator. SolarPaces, Las Vegas, 2013.

Future work:

- Performing parameter identification studies to match numerical models to mixing analyzed in experimental data
- Intensify evaluation and characterization of thermocline storage

IEE-CAS
(China)



Molten Salt Thermocline Thermal Storage Technology

Challenges:

- Traditional two tank molten salt thermal storage system need huge tons molten salt and very big storage tank which increase the cost of the CSP power plant.
- Single tank thermocline thermal storage system could greatly decrease the cost but there are not commercialized MS thermocline thermal storage system in real power plant.

State of the art:

- There a lot of parameters which influence the stability of thermocline thickness are still not systematically studied.
- How the unsteady inlet conditions and multicycle influence the thermocline are still well studied.
- A general dimensionless relation which could reflect the mechanism of thermocline is needed.

Concept approach:

- Mechanism research:
 - The influence of physical parameters on the thermocline system.
 - The influence of physical boundary conditions on the thermocline system.
- Advantages:
 - It is better to find the methods to improve the performance of the thermocline thermal storage system.
- Dynamic simulation for single and two tank combined thermal storage system:
 - Advantages: The new designed combined thermal storage system will have more stable thermocline and lower cost.

Current R&D status:

- The influence of parameters and physical boundary conditions have been finished numerical simulation

Further information:

Contact person: changzheshao@mail.iee.ac.cn

Publications:

- ZS Chang, X Li, C Xu, C Chang, ZF Wang. The design and numerical study of a 2MWh molten salt thermocline tank. Energy Procedia. 2015,69:779~789. SolarPACES 2014, September 16-19, 2014 in Beijing, China

Future work:

Continue all the work.

IEE-CAS
(China)



TASK III-TES

Two Tank Storage Using Molten Salt

Challenges:

- Narrow work temperature range of molten salt, especially the high freezing point=> extend the safe work temperature range, keep tube temperature by using electric heat tracing and change ratio of salt mixture.
- Large tank and abundant salt needed.
- Flexible control strategy of molten salt system => suitable control strategy.

State of the art:

The main and typical way of thermal storage in CSP power plants.

Concept approach:

- Extend the safe work temperature range:
 - Advantages: make full use of thermal potential.
 - Disadvantages: raise risk of accident.
- Change ratio of salt mixture:
 - Advantages: find low freezing point salt mixture.
 - Disadvantages: expensive.
- Suitable control strategy:
 - Set various system operation modes and use corresponding control methods when system runs.
 - Advantage: raise the whole thermal storage and efficiency.
 - Disadvantages: bad switch and salt left in specific tubes between modes changing.

Current R&D status:

- Suitable control strategy is under way.

Further information:

Contact person: lizhi@mail.iee.ac.cn

Future work:

- Build test facilities to do thermal storage experiments and optimize control strategy.

IEE-CAS
(China)



TASK III-TES

Two tanks TES using thermal oil

Challenges:

- High freezing point=>keep tank and tube temperature using electric heat tracing in winter.
- Low operation temperature=>using two stages TES to produce superheated steam to generate.

State of the art:

- The main and typical way of thermal storage in CSP power plants

Concept approach:

- Decrease freezing point:
 - Advantages: the system can be operation in winter without using electric heat.
 - Disadvantages: TES cost is higher.
- Two-stage TES:
 - TES composited thermal oil TES and steam TES which thermal oil as the high temperature TES and steam as the low temperature TES.
 - Advantage: improve TES efficiency.
 - Disadvantages: control strategy is not easy.

Current R&D status:

Two stages TES is the TES of 1MW CSP plant of Badaling CSP in Beijing, China.
Many experimental had finished.

Further information:

Contact person: wangyan955@126.com

Future work:

- Continue the simulation and experiment of two stages TES.
- Improve the storage performance and establish evaluation criterion of thermal oil thermal storage.

IEE-CAS
(China)



TASK III-TES

Solid packed bed thermal storage using high temperature air

Challenges:

- Low energy storage density of solid sensible thermal storage material=>composite sensible and latent material as thermal storage material
- The stability of packed bed thermal storage, especially the outlet temperature of air=>multiply thin tanks for ceramic sphere packed bed thermal Storage.

State of the art:

A few pilot's thermal storage systems are applied in CSP plant as second TES to investigate the performance, but not the main and typical TES system.

Concept approach:

- **Composite sensible and latent material as thermal storage material**

Advantages:

- The outlet temperature of discharging process is stability.
- Improve convection and conduction between air and thermal storage

Requirements:

- Encapsulating the sensible and latent materials
- Expand the thermocline area
- Low cost

Disadvantages:

- Leak of PCM materials.
- Multiply thin tanks packed bed thermal storage
 - Stability of the air outlet temperature.
 - Expand the discharging time.

Current R&D status:

- The heat transfer performance of packed bed thermal storage was investigated by experiment and simulation
- The 500kWh_{th} experimental test platform has finished
- Collaboration with other institution for solid thermal storage material

Further information:

Contact person: wangyan955@126.com

Publications:

- Yan Wang, Peiwen Li, zhifeng Wang, Bei Yang, Guofeng Yuan, Wenxun Tang. Longer passage of airflow in multiple packed-bed thin tanks versus in a short big tank for improved thermal storage performance. Proceedings of the ASME, v 6B-2018.
- Yan Wang, Peiwen Li, zhifeng Wang, Bei Yang, Guofeng Yuan. The benefit of using multiple thin tanks versus a short big tank for thermal storage in ceramic-sphere packed bed with airflow. Journal of Solar Energy Engineering, Transactions of the ASME, 2020. 4.142.2.

Future work:

- Control strategy investigation of cascade TES system under different operational parameters

IEE-CAS
(China)



TASK III-TES

Honeycomb ceramics used as storage media for CSP system using gas as heat transfer fluid

Challenges:

- High working pressure drop => optimization of the system design and operation
- Fluid outlet temperature decrease during discharging process => optimization design

State of the art:

Up to now, no operating system in CSP power plants.

Concept approach:

- **Thermal performance experiments**
 - **Advantages:**
 - Easy to get the performance of whole working process.
 - High thermal conductivity.
 - **Disadvantages:**
 - Not easy to get the optimization design

Current R&D status:

- Some experiments had finished

Further information:

Contact person: baifw@mail.iee.ac.cn

Future work:

- Finish the experiments and give the final evaluation of this technology. Do some simulations for the whole system and present the method of optimization of system design and operation.

IEE-CAS
(China)



TASK III-TES

solid particles thermal energy storage

Challenges:

- Solid particle heat storage media: thermal properties, stability at 1000°C, cost.
- Storage tank: thermal loss control, design method for large capacity around 10000 tons, cost.
- High temperature solid particles delivery equipment.

State of the art:

Some solid particle materials had developed focusing on the solid particle solar receiver. There are few published articles related to the thermal energy storage.

Concept approach:

- **Thermal performance experiments**
 - **Advantages:**
 - Easy to get the performance of whole working process.
 - High thermal conductivity.
 - **Disadvantages:**
 - Not easy to get the optimization design.

Current R&D status:

- Some experiments had finished.

Further information:

Contact person: baifw@mail.iee.ac.cn

Future work:

- Finish the experiments and give the final evaluation of this technology. Do some simulations for the whole system and present the method of optimization of system design and operation.

**IK4-TEKNIKER
(Spain)**IK4  TEKNIKER
Research Alliance**TASK III-TES****Molten Salts (MS) for TES****Challenges:**

- Condition monitoring of thermal and physical properties of these materials at working conditions
- Assessment of MS quality at different used stage
- Definition of operational limits for MS
- Synthesis of new MS with low melting temperature
- Find a compromise between low melting temperature T_m and corrosion properties of new MS

State of the art:

- There is not enough knowledge about the real service life of MS that operates in SCP plants

Concept approach:

Advanced test bench (up to 5kg) that can operate at real working conditions (P,T) with on line sensors to monitor chemical changes in the MS during ageing process

- Advantages:
 - New proposed materials for thermal storage application can be study/evaluated and characterize (thermal, physical and chemical properties)
 - Corrosion properties of constructive materials can be tested against thermal storage materials
 - New or current materials against new molten salts
 - New or current materials against current solar salts

Current R&D status:

- Advanced chromatographic techniques to evaluate MS composition
- Collaboration with other corporations to set up protocols for thermal characterization

Further information:Contact person:

- Nerea Uranga; (nerea.uranga@tekniker.es)
- Cristobal Villasante; (cristobal.villasante@tekniker.es)

Future work:

Continue the study of new thermal materials for TES

**IK4-TEKNIKER
(Spain)****TASK III-TES****ADVANCED Heat Transfer Fluids (HTF)****Challenges:**

- Enhance thermal properties (Cp, thermal storage)
- Wide working temperature window of current HTF
- Reduce HTF volume in the installation
- Define operational limits of HTF in use
- Condition monitoring of HTF through advanced analytical techniques

State of the art:

- Current HTF has a solidification temperature of 12°C and upper operational temperature at 398°C, with limited thermal storage properties.
- Quality assessment is based on very basic techniques (real aged state of HTF is not known)

Concept approach:

- Selective HTF additivation with thermal active additives
 - Microencapsulated thermal material (Phase Change Material, Ionic liquids, Salts)
 - Non-encapsulated thermal materials
- Advance test-bench to evaluate new or current HTF behavior under simulated working conditions (T, P)
- Advanced techniques based on chromatography to assess and quantify degradation. (Selective identification and monitoring of chemical compounds)

Current R&D status:

- Collaboration with HTF manufacturers
- HTF with IL has higher thermal resistance without change pumpeability properties

Further information:Contact person:

- Marta Hernaiz; (marta.hernaiz@tekniker.es)
- Cristobal Villasante; (Cristobal.villasante@tekniker.es)

Publications:

- M.Hernaiz, N. Uranga Improved thermal fluids WO 2013182713 A1
- M. Hernaiz, E.Aranzabe LUBMAT 2012: "Condition monitoring of heat transfer fluid in parabolic trough collectors of solar power plants"
- M. Hernaiz SCP Today 2013-Strategies to improve solar heat transfer fluids behavior
- M. Hernaiz, N.Uranga LUBMAT 2012: "Improvement of solar heat transfer fluid behavior at low temperature by dispersing encapsulated and non encapsulated phase change materials (PCM)

Future work:

Continue in the research line of development "advanced HTF" with the aim of improve thermal properties

Green Energy Park – IRESEN (Morocco)



TASK III-TES

Solid filler materials

Challenges:

- Providing low cost and high-density solid fillers for sensible heat storage with suitable thermal properties and mechanical/chemical/thermal stability.
- Ensuring a fast and efficient numerical and experimental validation protocol for the proposed solid fillers under various operation conditions and HTF's.
- Screening of potential solid fillers availability for large-scale use in CSP target regions.

State of the art:

- Experimental data available for natural fillers but in very limited diversity and some lack of relevance regarding availability and logistic considerations.
- Multiple numerical models for dual media thermocline systems simulation but limited experimental data available for such systems.

Concept approach: (mentioning advantages & disadvantages)

- Natural materials as solid fillers for dual media thermocline
- Advantages
 - Low cost materials especially if available near user's location.
 - Potentially suitable for a wide range of temperatures and fluids.
 - Higher local content and lower carbon footprint.
- Challenges
 - Establishing a smooth process for filler selection and validation under operational conditions.
 - Appropriate mapping of available and exploitable materials near candidate CSP/end-user sites.
 - Simple and reliable method necessary for long term durability proof.

Current R&D status:

- Experimental characterization and mapping of natural candidate fillers.
- Study of synthesis possibilities for recycled industrial solid wastes.
- Preparation of a small-scale thermal oil testing and cycling facility for materials validation.

Further information:

Contact person : Khadija EL ALAMI (elalami@iresen.org)/ Hrifech soukaina (Hrifech@iresen.org)

Publications:

- K. El Alami, M. Asbik, H. Agalit, Identification of natural rocks as storage materials in thermal energy storage (TES) system of concentrated solar power (CSP) plants – A review, *Solar Energy Materials and Solar Cells*, 2020. <https://doi.org/10.1016/j.solmat.2020.110599>
- S. Hrifech, H. Agalit, E. G. Bennouna, et A. Mimet, « Potential Sensible Filler Materials Thermal Energy Storage for Medium Range Temperature », in *Proceedings of the 1st International Conference on Electronic Engineering and Renewable Energy*, vol. 519, B. Hajji, G. M. Tina, K. Ghoumid, A. Rabhi, et A. Mellit, Éd. Singapore: Springer Singapore, 2019, p. 755-761.

Future work:

- Continue the work on natural resources and recycled industrial wastes mapping and characterization.
- Validation and improvement of simulation models and material selection method with experimental data from thermocline TES prototypes.

**Masdar Institute
(Emirates)**



TASK III-TES

ACTIVITY: Concentrated Solar Power on Demand Demonstration project (CSPonD)

Challenges:

- Use of beam down technology
- Combination of TES system and volumetric receiver
- Single storage tank based on thermocline concept
- Demonstrate the technical and economic viability of the concept

State of the art:

Although there are only a few proposed concepts using one tank as TES system, this is the first time that it is combined with the receiver.

Concept approach:

Advantages:

- Reduction of parasitic losses inherent to commercial CSP plants
- Higher concentration Final Optical Element (FOE) because acceptance angle from CR is small compared to FOE for tower system
- Conical FOE. Improved spatial and angular distribution of flux at receiver aperture

Requirements

- An insulated divider is needed between hot and cold salts stored in the one tank TES system
- Use of commercially available components and materials

Current R&D status:

- Current prototype almost finished and being tested at Masdar Institute Solar Platform

Further information:

Contact person: Nicolas Calvet (ncalvet@masdar.ac.ae)

Publications:

- Concentrated solar power on demand, Alexander H. Slocum et al., Journal of Solar Energy, Volume 85, pp. 1519-1529, 2011
- Preliminary optical, thermal and structural design of a 100 kWth CSPonD beam-down on-sun demonstration plant, Benjamin Grange et al., Proceedings of the seventh international conference of applied energy, March 28-31, 2015, Abu Dhabi [UAE]

Future work:

- Improvement of FOE
- Improvement of divider plate
- Testing at industrial prototype scale

**SIJ: Solar-
Institut Jülich
(Germany)**

FH AACHEN
UNIVERSITY OF APPLIED SCIENCES
SIJ | SOLAR-INSTITUT JÜLICH



TASK III-TES

multiTESS: Innovative Power-to-Power&Heat-Concept

Challenges:

- Thermal high-temperature storage operating up to 1000 °C as a central element for the temporal decoupling of generation and demand
- Innovative electrical heating concept with a temperature range up to 1000 °C
- Start-up of system
- Control of the overall system

State of the art:

- Electrical air-heater up to 750 °C
- No commercial storage in the area of electricity generation above 600 °C available
- Power-to-heat concepts up to 115 °C

Concept approach:

- Development of an electro-thermal energy storage working at 1000 °C that allows multiple options of discharging (electrical power and heat at different temperature levels)
- In order not to be restricted to a thermal energy source for charging, an electrical heater will be implemented to use all kinds of renewable electricity to charge the storage
- A proven design of a high-temperature ceramic storage will be adapted and used for this concept

Advantages:

- Flexible and decentralized supply of heat and electricity based on renewable energy
- Contribution to the decarbonisation of the industry sector
- Heat supply at different temperature levels up to 1000 °C
- Highly cost-efficient electricity storage
- New approach of sector coupling
- Can easily be extended by a gas heater to provide firm capacity also during dark doldrums

Disadvantages:

- Electricity used for charging will partly discharged as heat and partly as electricity. The distribution may vary with the application

Current R&D status:

- Construction of pilot plant: *multiTESS* – multifunctional electro-thermal energy storage
- The design and dimensioning of the storage module is based on the experiences gained with the storage module at the Jülich solar tower



Further information:

Contact person: Prof. Dr. Ulf Herrmann (ulf.herrmann@sj.fh-aachen.de)

Publications:

- Herrmann, U., Dittmann-Gabriel, S., May, M., et al.: Hochtemperatur-Wärmespeicher für die Strom- und Wärmewende (2019), in „Solarzeitalter, 31. Jahrgang, 2/2019, pp.18-23“

Partner: Kraftanlagen München GmbH, Otto Junker GmbH, Dürr Systems AG

Future work:

- Pilot plant performance analyses under transient operating conditions
- Optimization of the overall system
- Integration of different types of heat engines
- Evaluation and verification of technical and economic feasibility

**SIJ: Solar-
Institut Jülich
(Germany)**

FH AACHEN
UNIVERSITY OF APPLIED SCIENCES
SIJ | SOLAR-INSTITUT JÜLICH



Air - bulk material heat exchanger for Thermal Energy Storage (VeSuW)

Challenges:

- Avoiding fluidic phenomenologies of direct material contact.
- Structural durability at over 800°C

State of the art:

- Fluid bed heat exchanger: high operating costs.
- Trickle film counterflow heat exchanger: low energy transport rate.
- Rotary heat exchanger: high investment and operation costs.
- Shell and tube heat exchanger: high pressure losses and investment costs.

Concept approach:

- Iterative development based on laboratory experiments and computational simulations.
- Particle tracking via PIV.
- Investigation of long-term rheology of bulk materials.
- Combination of fluid and DDEM simulations.

Advantages:


- Highest energy transport density and efficiency.
- Limited plant complexity (low investment costs).
- Lower operating costs.
- Good scale ability.

Disadvantages:

- Height Requirements.
- Material cross-contamination.

Current R&D status:

- Short-term tests with various experimental heat exchangers.
- Construction of an automated test rig.
- Designing and simulating of the 6th revision.

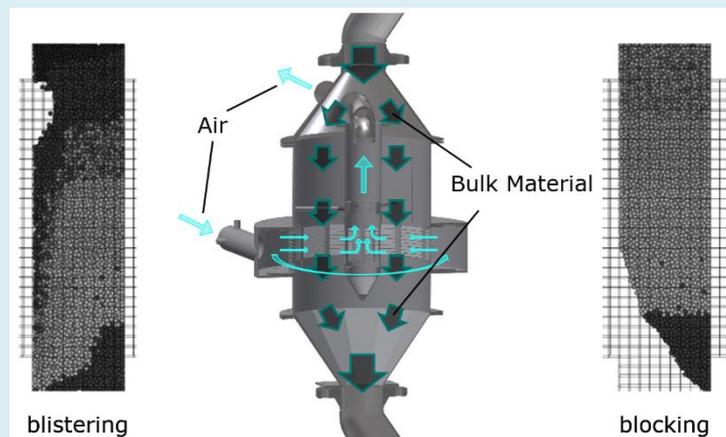

Further information:

Contact person: Prof. Dr. Ulf Herrmann (ulf.herrmann@sj.fh-aachen.de)

Website: Herrmann, U., Teixeira Boura, C., Skoda, S., Sattler, J.C.; [VeSuW](#), [HiTexStor](#)

Future work:

- Optimizing the overall efficiency regarding pressure and insulation losses.
- Optimizing lifespan and operating costs.
- Transfer innovation to the next level

**SIJ: Solar-
Institut Jülich
(Germany)**

FH AACHEN
UNIVERSITY OF APPLIED SCIENCES

SIJ | SOLAR-INSTITUT JÜLICH



TASK III-TES

Power-to-heat technologies (P2H) combined with molten salt storage for the application in industry and in PV-CSP hybrid power plants

Challenges:

- Determination of the most effective design of a P2H system with molten salt storage (Carnot battery) to use surplus electricity in industrial processes and PV-CSP hybrid power plants
- Commercial heat pumps are limited in temperature. An adequate medium has to be found

State of the art:

- Heat pump with vapor-compression cycles are currently limited to temperatures up to 160 °C
- Molten salt storage tanks are deployed in many of the current CSP plants worldwide. Solar salt (a mixture of 60 % NaNO₃ and 40 % KNO₃) is the standard medium used in this type of power plants. The maximum temperature is in the range of 550 – 580 °C
- Electric heaters are used in many different industries, such as processing plants, chemical, food processing, medical, pharmaceutical, utilities, marine, oil and gas, etc.

Concept approach:

- Carnot batteries make it possible to use surplus energy from the power grid converting it into heat. The energy is stored as heat in molten salt tanks and it can be used at a later time to drive industrial processes. Two P2H concepts are investigated: Electric heaters and heat pumps
- The system contributes to grid stability and has the advantage that renewable energy sources with fluctuating power input do not have to be switched off for grid or frequency stabilization. This creates additional capacity for energy production from renewable energy sources
- The design of the two P2H technologies is also being examined in an innovative concept for their application in PV-CSP hybrid power plants. Low-cost PV electricity is temporarily stored in the Carnot battery and consequently offered according to demand

Current R&D status:

- Development of a dynamic model of a resistance heater with molten salt storage
- Technical parameter analysis of different high temperature heat pump concepts
- Development of high temperature heat pump models for simulating different power capacities and media
- Market analysis of different industrial branches and energy intensive processes

Further information:

Contact person: Dipl.-Ing. Cristiano Teixeira Boura (boura@sj.fh-aachen.de)

Website: <https://www.fh-aachen.de/en/research/solar-institute-juelich/focus-areas/projects-solar-thermal-systems/>

Future work:

- Performance simulations for different industrial consumers
- Performance simulations for different concepts in PV-CSP hybrid power plants

**SIJ: Solar-
Institut Jülich
(Germany)**

FH AACHEN
UNIVERSITY OF APPLIED SCIENCES

SIJ | SOLAR-INSTITUT JÜLICH



TASK III-TES

SpOpt: storage optimization for the Jülich solar tower power plant

Challenges:

The focus of this work is to increase the degree of utilization as well as the flexibility and cost-effectiveness of the storage system of the Jülich solar tower power plant.

State of the art:

The STJ storage system basically shows the behavior of a regenerator. In case of high solar radiation, part of the thermal energy can be stored and discharged again if necessary. The control of the air flow is achieved by means of valves and the output regulation of two blowers.

Concept approach:

- Development of an optimized air circuit and storage system for solar thermal power plant concept with open volumetric receiver
- The aim is to achieve the highest possible plant efficiency and high electricity production when investigating the air flow within the storage system.
- Determination of operating modes that preserve the conventional part of the plant (especially the steam generator and turbine), thus increase its durability, and allow the use of less robust but more efficient components.
- Exploitation of the optimisation possibilities of the storage configuration and the operating strategies, with regard to flexibility, stable energy discharge, power generation and efficiency.

Current R&D status:

- **For the simulation of the storage model as well as of the complete solar tower power plant with open volumetric receiver a component library was developed.**
- Several optimized storage concepts have been developed and assessed in terms of their flexibility, temperature stability during discharge mode as well as power yield, operational costs and efficiency of the overall system. The operating strategies of the storage system have been adjusted to fit into the overall operating strategy of the power plant. For this purpose, annual calculations of the storage systems were carried out with optimized process control. One of the implemented and analyzed storage concepts showed improvements in the start-up process of the power plant and consequently leads to an increase in the absolute power generation.

Further information:

Contact person: Prof. Dr. Ulf Herrmann (ulf.herrmann@sj.fh-aachen.de)

Publications:

- Kronhardt, V.; Alexopoulos, S.; Reißel, M.; Latzke, M.; Rendon, C.; Sattler, J.; Herrmann, U.: "Simulation of operational management for the Solar Thermal Test and Demonstration Power Plant Jülich using optimized control strategies of the storage system" (2014), in „ Energy procedia. 2015. Seite: 1 - 6“
- Kronhardt, V.; Alexopoulos, S.; Reißel, M.; Sattler, J.; Hoffschmidt, B.; Hänel, M.; Doerbeck, T.: "High-Temperature Thermal Storage System for Solar Tower Power Plants with Open-Volumetric Air Receiver." (2013), in „ Energy procedia. Vol. 49 (2014). Seite: 870 - 877 “

Future work:

- Investigation of possible future hybridization of the tower power plant in Jülich
- Upscaling of the regenerative storage system for follow-up power plant projects

**SIJ: Solar-Institut
Jülich
(Germany)**

FH AACHEN
UNIVERSITY OF APPLIED SCIENCES
SIJ | SOLAR-INSTITUT JÜLICH



TASK III-TES

Interconnection of Molten Salt Storage Tanks

Challenges:

Most of the modern parabolic trough collector (PTC) power plants and solar tower power plants deploy molten salt tanks to store thermal energy. The retrofitting of PTC power plants with molten salt tower system is investigated to prolong the discharge capacity of the existing PTC storage. The main challenges are:

- Investigate the most effective coupling possibility of PTC and solar tower storage systems
- The dispatchability of commercial PTC plants is determined by existing contractual terms and conditions. Retrofitting with an increase in power capacity requires a redefinition of the contractual conditions.

State of the art:

Most commercial PTC power plants deploy thermal oil as heat transfer fluid with indirect two-tank molten salt thermal energy storage. The operating temperature of the thermal oil is limited to 430 °C; thermal oil absorbs energy from concentrated solar irradiation to provide the heat needed for generating steam in a power cycle. A binary mixture of 60 % NaNO₃ and 40 % KNO₃, also denoted as Solar salt, has become the standard medium for commercial solar thermal storage systems (PTC as well as molten salt tower systems). The melting temperature is in the range of 230 °C and the maximum temperature is in the range of 550 - 580 °C.

Concept approach: (mentioning advantages & disadvantages)

- Development and implementation of operating strategies to extend storage discharge capacity
- Determination of the most effective storage configuration for thermal load shifting between PTC and molten salt tower storage tanks
- Design and annual performance simulations of a combined storage system

Current R&D status:

Simulations have shown that an interconnection between the salt storage systems of a combined PTC-molten salt tower power plant extends the discharge operation time of the existing PTCs storage system. The developed storage configuration positively contributes to a reliable and continuous power generation, especially during winter.

Further information:

Contact person: Carlos Rendón; (rendon@sj.fh-aachen.de)

Publications:

- Rendón, C., et al. (2018), Retrofitting of existing parabolic trough collector power plants with molten salt tower systems. AIP Conference Proceedings 2033, 030014 (2018); <https://doi.org/10.1063/1.5067030>

Future work:

Further investigation on the developed storage configuration.

**SIJ: Solar-Institut
Jülich
(Germany)**

FH AACHEN
UNIVERSITY OF APPLIED SCIENCES

SIJ | SOLAR-INSTITUT JÜLICH



TASK III-TES

EDITOR: Parabolic Trough Collector with Concrete Thermal Energy Storage

Challenges:

- Creation and validation of an accurate dynamic simulation model of a concrete thermal energy storage (C-TES)
- Reduced model complexity to maintain an acceptable simulation speed
- Implementation of C-TES model in overall system model including a parabolic trough collector model, a steam boiler model, pump model and system controller.
- Model stability of dynamic overall system with respect to switching of operation modes

State of the art:

- A state-of-the-art parabolic trough collector system with concrete thermal energy storage is in operation on the premises of KEAN Soft Drinks Ltd in Limassol, Cyprus. See website URL in the section "Further information" below.

Concept approach:

- Creation of the model according to the design parameters from the real storage system
- Pre-validation with design parameters
- Optimisation and implementation of C-TES operation modes
- Validation with measurement data from real plant operation
- Scale-up simulation of C-TES for full dispatchability.

Current R&D status:

- A fully functional dynamic C-TES model in reduced complexity was developed and implemented in the overall system model described above.
- The overall system model uses all operation modes of the real system
- A stand-alone, high complexity model of the C-TES with fast simulation speed can also be used to evaluate the performance of the C-TES alone
- The C-TES model is validated

Further information: (contact person, most relevant papers in journals & conferences, web pages, associated funded project)

- Contact: Prof. Dr.-Ing. Spiros Alexopoulos; alexopoulos@sij.fh-aachen.de
- Project EDITOR, Solar-Institut Jülich <https://www.fh-aachen.de/en/research/solar-institute-juelich/focus-areas/editor/>
- J. C. Sattler, S. Alexopoulos, R. A. Chico Caminos, J. Mitchell, V. Ruiz, S. Kalogirou, P. Ktistis, C. Teixeira Boura, U. Herrmann, "Dynamic Simulation Model of a Parabolic Trough Collector System with Concrete Thermal Energy Storage for Process Steam Generation", AIP Conference Proceedings **2126**, 150007 (2019); <https://doi.org/10.1063/1.5117663>
- J. C. Sattler, R. A. Chico Caminos, V. Atti, N. Ürlings, S. Dutta, V. Ruiz, S. Kalogirou, P. Ktistis, R. Agathokleous, S. Alexopoulos, C. Teixeira Boura, U. Herrmann, "Dynamic Simulation Tool for a Performance Evaluation and Sensitivity Study of a Parabolic Trough Collector System with Concrete Thermal Energy Storage", to be published in AIP Conference Proceedings in 2020.
- J. C. Sattler, R. A. Chico Caminos, N. Ürlings, S. Dutta, V. Ruiz, S. Kalogirou, P. Ktistis, R. Agathokleous, C. Jung, S. Alexopoulos, V. Atti, C. Teixeira Boura, U. Herrmann, "Operational Experience and Behaviour of a Parabolic Trough Collector System with Concrete Thermal Energy Storage for Process Steam Generation in Cyprus", to be published in AIP Conference Proceedings in 2020.

Future work:

- Deployment and optimisation of C-TES model and operation modes in future projects

**SIJ: Solar-
Institut Jülich
(Germany)**

FH AACHEN
UNIVERSITY OF APPLIED SCIENCES
SIJ | SOLAR-INSTITUT JÜLICH



Electro-thermal energy storage technologies in combination with power-to-heat systems (P2H) for the application in coal-fired power plants, PV-CSP hybrid power plants, etc. within different research projects

Challenges:

- Determination of the most effective design of a **P2H system with molten salt storage (electro-thermal energy storage)** to use surplus electricity in industrial processes and PV-CSP hybrid power plants
- Investigation of a proper medium for the application in high-temperature heat-pumps
- Development of the conversion of a coal-fired power plant into an electro-thermal energy storage system on an economical GWh scale

State of the art:

- Heat pump with vapor-compression cycles are currently limited to temperatures up to 160 °C
- Molten salt storage tanks are deployed in many of the current CSP plants worldwide. Solar salt (a mixture of 60 % NaNO₃ and 40 % KNO₃) is the standard medium used in this type of power plants. The maximum temperature is in the range of 550 – 580 °C
- Electric heaters are used in many different industries, such as processing plants, chemical, food processing, medical, pharmaceutical, utilities, marine, oil and gas, etc. and technically implementable on a GW scale
- Electrical storage systems are currently only on a MWh scale available

Concept approach:

- Electro-thermal energy storages make it possible to use surplus energy from the power grid converting it into heat. The energy is stored as heat in molten salt tanks and it can be used at a later time
 - to drive the power plant for electrical power generation and supply district heating networks
 - to drive industrial processes
- Two P2H concepts are currently investigated: electric heaters and heat pumps
- The systems contribute to grid stability and have the advantage that renewable energy sources with fluctuating power input are not to be switched off for grid or frequency stabilization. This creates additional capacity for energy production from renewable energy sources
- The design of the two P2H technologies is also being examined in an innovative concept for the application in PV-CSP hybrid power plants. Low-cost PV electricity is temporarily stored in the electro-thermal energy storages and consequently offered according to demand
- The market potential for the electro-thermal energy storage power plant coupled to district heating networks are being investigated under economic aspects

Advantages and disadvantages of the storage system:

- + Ensuring supply security of electrical energy without coal-fired power plants
- + Ongoing use of coal-fired power plant infrastructure after coal phase-out
- + Short-term contribution to energy system transformation and socially acceptable coal exit
- + Can be built and operated independently of geographical or geological conditions, unlike pumped storage power plants
- + Good scalability
- + Simple extension with a gas heater to provide firm capacity also during dark doldrums
- Certain minimum spread on the electricity market required. No economically viable operation yet

Current R&D status:

- Completed study on the integration of thermal power storage systems into existing power plant facilities (I-TESS study, 2017): Development of the technical concepts, determination of investment costs, analysis of options for the integration of such electro-thermal power storage systems in existing power plants
- Development of concepts for upgrading CHP coal-fired power plants by adding a high-temperature heat storage system with electric heating
- Risk analysis and Life Cycle Assessment of electro-thermal energy storage power plants
- Development of a dynamic model of a resistance heater with molten salt storage
- Technical parameter analysis of different high temperature heat pump concepts
- Development of high temperature heat pump models for simulating different power capacities and media
- Market analysis of different industrial branches and energy intensive processes

Further information:Contact persons:

- Prof. Dr. Ulf Herrmann (ulf.herrmann@sj.fh-aachen.de)
- Dipl.-Ing. Cristiano Teixeira Boura (boura@sj.fh-aachen.de)

Website: <https://www.fh-aachen.de/en/research/solar-institute-juelich/focus-areas/projects-solar-thermal-systems/>

Future work:

- Performance simulations for different industrial consumers
- Performance simulations for different concepts in PV-CSP hybrid power plants
- Investigation of other storage concepts for the carnotisation of the thermodynamic processes

**SUPSI, ETHZ
ALACAES
(Switzerland)**

University of Applied Sciences and Arts
of Southern Switzerland

SUPSI



TASK III-TES

Numerical and experimental analysis of a packed bed TES system suitable for Adiabatic Compressed-Air Energy Storage (A-CAES) technology

Challenges:

- TES systems operating at high temperature (550°C) and high pressure (up to 100 bars).
- Experimental investigation on the pilot plant for demonstrating the applicability of A-CAES technology.

State of the art:


In the field of large-scale electric energy storage, a valid alternative to pumped hydroelectric energy storage is represented by compressed-air energy storage (CAES). As of today, two CAES plants are successfully in operation: the 321 MW Huntorf plant (Germany) and the 110 MW McIntosh plant (USA). The round-trip efficiency of these CAES plants, 42% and 54% for the former and the latter respectively, is limited by the fact that the thermal energy produced during compression is wasted and therefore they need to burn fuel to increase the enthalpy of the compressed air prior to expansion. To overcome the limitation of conventional CAES plants, the A-CAES concept has been proposed. In this technology, a TES is exploited to store the thermal energy produced during compression to be recovered prior to expansion. The expected round-trip efficiency of A-CAES is in the order of 70%.

Concept approach:


- Since the TES can be considered the key component of the A-CAES technology, its thermo-fluid dynamics behavior has been carefully evaluated by means of computational fluid dynamics (CFD) simulations.

Current R&D status:


- To evaluate the feasibility and applicability of the AA-CAES concept, the first pilot plant has been built in Pollegio (CH). A 120 m long section of an existing tunnel in the Swiss Alps has been exploited as high-pressure air reservoir (up to 33 bars). The latter was enclosed by building two 5 m thick concrete plugs at the two ends. A single-tank TES, based on a 44 m³ packed bed of natural rocks, has been installed into the pressure chamber.

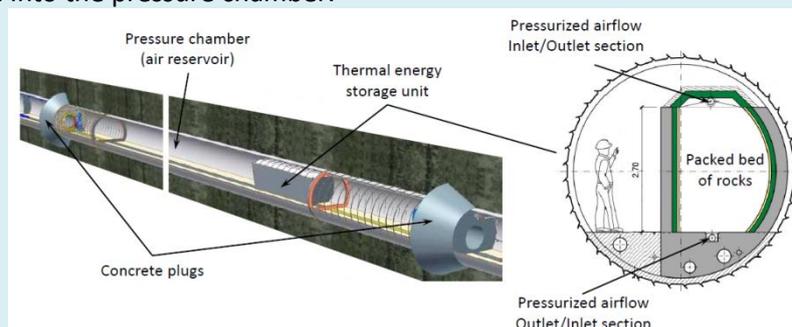

- A 2D and 3D CFD modeling approach has been developed to evaluate the performance of the TES unit under investigation. The numerical model has been successfully validated with experimental data gathered from the Pollegio A-CAES pilot plant.

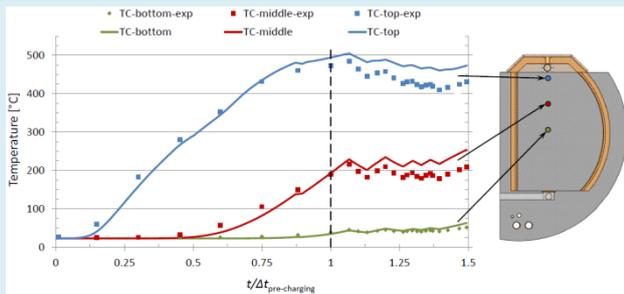

Numerical model validation: simulation results (solid lines) VS experimental data (markers)

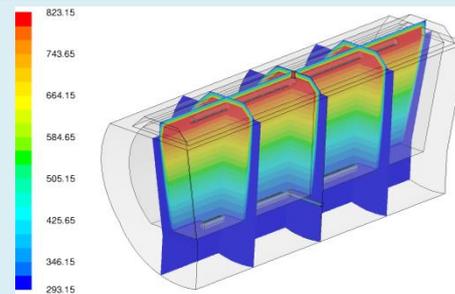

TES unit temperature contours (Temperature [K])

Further information:

Contact person: Mr. Simone Zavattoni (simone.zavattoni@supsi.ch)

Publications:

- S.A. Zavattoni, L. Geissbühler, M.C. Barbato, G. Zanganeh, A. Haselbacher, A. Steinfeld, "CFD modeling of the Pollegio A-CAES pilot plant TES system", Swiss Competence Centre for Energy Research for Heat and Electricity Storage (SCCER-HaE), Annual report, 2016.

Future work:

Evaluating the effect of exploiting a combined sensible/latent heat TES solution.

**SUPSI, ETHZ
ALACAES
(Switzerland)**

University of Applied Sciences and Arts
of Southern Switzerland

SUPSI

SolarPACES
TASK III-TES

Performance evaluation of the TES system integrated into the first pilot plant using air as heat transfer fluid

Challenges:

- Accurate description of the thermo-fluid dynamics behavior, and performance evaluation under cyclic conditions, of the packed bed TES unit integrated into the pilot plant.

State of the art:

Single-tank, or thermocline, TES systems represent a reliable and affordable alternative to the commonly exploited two-tank solution in conventional CSP plants. Computational fluid dynamics (CFD) is a valuable tool for accurately analyzing the thermo-fluid dynamics behavior of this kind of TES allowing to predict the overall system performances.


Concept approach:

- A previously validated computational fluid dynamics (CFD) approach was followed to evaluate the thermo-fluid dynamics behavior of the TES unit under investigation subjected to a total of 5 pre-charging cycles followed by 60 consecutive cycles.
- The TES performance was also evaluated on the basis of the first- and the second-law of thermodynamics.


Current R&D status:

- The first 3 MW_{th} parabolic trough CSP pilot plant using air as heat transfer fluid has been constructed in Ait-Baha (Morocco).
- A packed bed TES unit, 100 MWh_{th} capacity, has been integrated into the pilot plant and accurately


analyzed by means of transient CFD simulations:

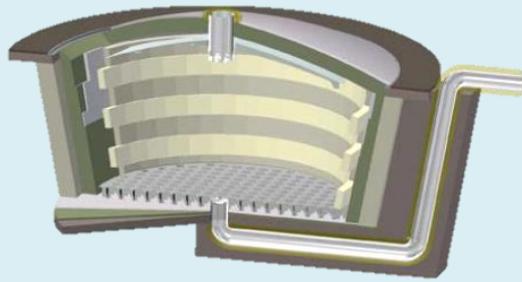

CAD model of the TES unit

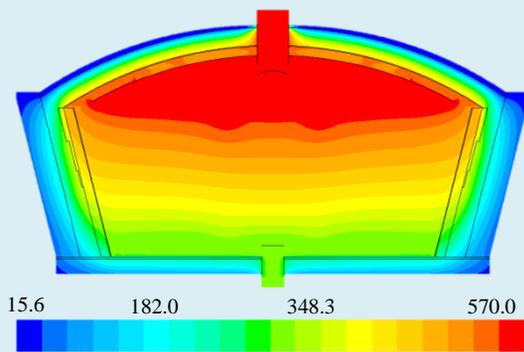

45th charging – Temperature contours (°C)

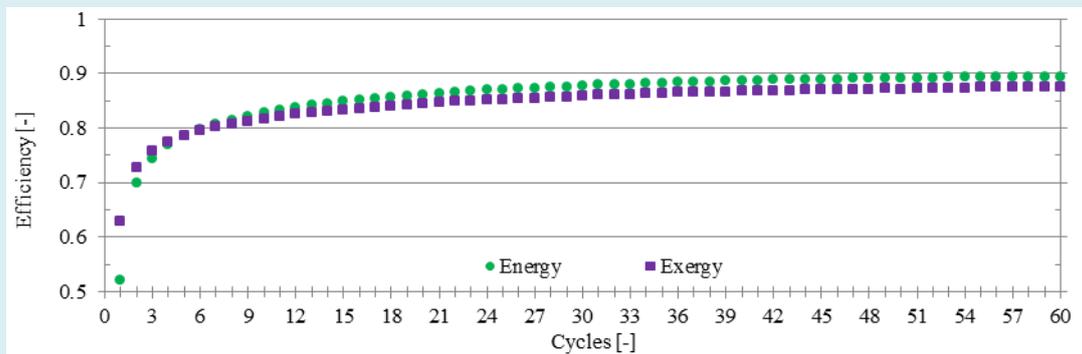

Resulting transient TES performance evaluation

Further information:

Contact person: Mr. Simone Zavattoni (simone.zavattoni@supsi.ch)

Publications:

- S. A. Zavattoni, G. Zanganeh, A. Pedretti, and M. C. Barbato, " Numerical analysis of the packed bed TES system integrated into the first parabolic trough CSP pilot-plant using air as heat transfer fluid," 23rd SolarPACES conference, 2017.
- S. A. Zavattoni, G. Zanganeh, A. Pedretti, and M. C. Barbato, "High temperature thermocline TES – Effect of system pre-charging on thermal stratification," AIP Conference Proceedings 1734 (050043), 2016.

Future work:

Evaluating the effect of some key parameters on thermal stratification.

TECNALIA
(Spain)



TASK III-TES

Thermal Energy Storage (TES)

Challenges:

- Thermal Energy Storage solutions for very high temperature CSP: Novel salt mixtures, metallic and nano-enhanced HTFs, storage tank concepts and designs.
- Find a solution for thermal storage in DSG: research on metallic and nanosalt PCMs.
- Cost reduction of state of the art solutions, focused on TES and container materials.

State of the art:

Current TES systems are based on the double-tank concept. In spite their good performance and robustness, next generation CSP plants requires new materials and engineering concepts.

Concept approach:

TES FOR VERY HIGH TEMPERATURE CSP PLANTS.

- Advantage: other materials and concept solutions from other sectors where high temperatures are involved, such as space technology, can be transferred to CSP.
- Disadvantage: increased cost of materials and components. Gained efficiency needs to show a higher economic benefit than the extra cost.

TES FOR CSP PLANTS BASED ON DSG TECHNOLOGY. The research is focused on the development of PCMs and novel engineering structures to be used as PCM containers.

- Advantage: a higher amount of energy stored per unit of volume and, therefore lower costs per kWh will be achieved.
- Disadvantage: a balance must be reached between the higher cost of PCM materials and the savings derived from their application.

COST REDUCTION IN CURRENTLY USED SYSTEMS. Our interest is the research on novel nanostructured materials based on inorganic salts with enhanced heat transfer properties.

- Advantage: the amount of storage media is significantly reduced. This will have an impact on the global cost of the TES system.
- Disadvantage: further research is required to ensure the good performance and stability of these novel TES materials.

Current R&D status:

- Analysing other technologies for high temperature applications.
- Synthesis of low melting point metallic alloys and novel nanosalts as PCM for DSG.
- Optimization of heat transfer rate of current inorganic salts for double tank systems.

Further information:

- Contact person: Javier Nieto ; javier.nieto@tecnalia.com
- Muñoz-Sánchez B. et al. Assessment of the determination of Specific Heat of Molten Salt doped with Nanoparticles by means of the DSC Technique. Greenstock. Beijing 2015
- Muñoz-Sánchez B. et al. Nanoparticle Size Evaluation through Dynamic Light Scattering (DLS) technique in a Nitrate Salt doped with Ceramic Nanoparticles. CIEM15. París (2015)
- Nieto-Maestre J. et al. Novel Metallic Alloys as Phase Change Materials for Heat Storage in Direct Steam Generation Applications. SolarPACES15. Cape Town (2015).

Future work:

- TES for very high temperatures: techno-economic analysis of considered concepts.
- TES for DSG: characterization of metallic and nanostructured PCMs. Compatibility with container materials and stability of physical and chemical properties.
- Sensible TES: more stable nanofluids based on salts with wider working temperature range

LATENT HEAT STORAGE

CEA – LITEN
(France)



TASK III-TES

Latent Heat Storage with Phase Change Materials

Challenges:

- No available storage technology at commercial stage for DSG plants.
- Pure NaNO_3 is an attractive solution due to its favorable physical properties and low cost, but its low thermal conductivity impacts on the size and cost of the storage.
- The Latent Heat Storage module is the critical component for the storage system of a DSG solar plant; indeed it stores more than 50% of the total thermal energy.

State of the art:

- Graphite as heat transfer matrix below 250 °C.
- Encapsulated concept with metallic envelopes, not favorable for high pressure applications.
- Vertical bundle of parallel tubes with high pressure condensing/evaporating water inside and a static PCM volume outside.

Concept approach: Low cost and robust heat transfer enhancement methods on the PCM side, for example using aluminum inserts around the vertical finned tubes:

Current R&D status:

- Small experimental loop with transparent test sections for visualization and phenomenological observation of low temperature PCM.
- Two PCM storage modules (3 m^3 and 1 m^3) have been tested successfully on the *LHASSA* experimental facility:
 - Test campaigns to validate the thermo-hydraulic behavior of the storage under operating conditions similar to commercial DSG CSP plants,
 - Measured storage performances meeting the specifications,
 - Optimized operating procedures,
 - Good agreement with simulation results given by dynamic models developed at CEA,
- A demonstrator-scale ($\approx 9 \text{ m}^3$) PCM storage integrated in a CSP Fresnel power plant prototype was built and is under testing.
- A facility (*DURASSEL*) for accelerated ageing tests of pressurized tubes in PCM ($\approx 25 \text{ l}$) is under commissioning.
- Validated multi-scale modelling approach (CFD and system model)

Further information:

Contact person: Pierre Garcia (pierre.garcia@cea.fr)

Publications:

- Olcese M, Couturier R, Fourmigué JF, Garcia P, Raccurt O, Robin JF, Senechal B, Rougé S, Thonon B. Design methodology and experimental platform for the validation of PCM storage modules for DSG solar plants, 19th SolarPACES International Symposium, Las Vegas, USA, 17-20 september 2013.
- Garcia P, Olcese M, Rougé S. Experimental and numerical investigation of a pilot scale latent heat thermal energy storage for CSP power plant, *Energy Procedia* 69, 842-849 (2015).
- Garcia, P., Rougé, S., Nivelon, P. Second test campaign of a pilot scale latent heat thermal energy storage - Durability and operational strategies, *AIP Conf. Proc.* 1734, 050016-1–050016-7 (2016).
- Beust C., Franquet E., Bédécarrats J.P., Garcia P. Predictive approach of heat transfer for the modelling of large-scale latent heat storages, *Renewable Energy* 157, 502-514 (2020).

Future work:

- Further tests on the *Alsolen450* demonstrator and further durability tests on *Durassel* experimental facilities

**CIEMAT-PSA
(Spain)**



TASK III-TES

Simulation and test of latent energy storage modules

Challenges:


- Designs with enhanced heat transfer for PCMs with low thermal conductivity
- Heat carrier at high pressure (up to 100 bar) => mechanical stability of design
- High grade of volume change during phase change
- Operation characteristics of storage

State of the art:

- Graphite as heat transfer matrix → only applicable below 250°C and as fin structure, not as expanded matrix.
- Encapsulated concept with metallic envelopes → relation of containment material to PCM not favorable for high temperature applications. Problems for manufacturing metallic envelopes
- Aluminum fins → may have problems of corrosion


Example of module with graphite fins

- 100 kW module tested at PSA under real DSG conditions
- eu- $\text{NaNO}_3/\text{KNO}_3$ mixture as PCM sandwiched with expanded graphite
- The model behavior can be represented by temperatures of the middle part
- Power decreases with time ⇒ Real mean power 40-50 kW
- PCM excess not efficiently conferring strong thermal inertia to the whole module

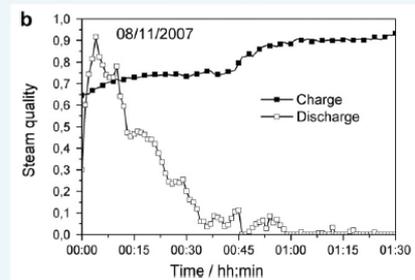

Example of module with spiral geometry

- Large heat exchange area due to spiral geometry -> efficient theoretical heat transfer between PCM and HTF
- 6 kWh module tested at PSA which is an adaptation of a commercial spiral HX
- HITEC salt as PCM
- Experimental results showed stagnation of steam at the upper part and a much lower phase change enthalpy of HITEC.
- No feasible for high steam pressures and high storage capacities

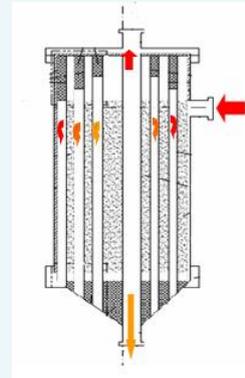

Further information

Contact person: Dr. Esther Rojas (esther.rojas@ciemat.es)

Publications:

- Rodríguez-García, M.M.; Rojas E., Testing a new design of latent storage, ISES EuroSun 2016,
- Rivas, E.; Rojas, E.; Bayon, R.; 2012, Innovating Storage with PCM: Progress in the Design of a New Prototype, 18th SolarPACES International Symposium. Marrakesh, Morocco.
- Rivas, E.; Rojas, E.; Bayón, R. 2011, (~Storage module using latent heat with highly efficient energy transfer). Patent Number: P201131378 (Spain).
- Bayón, R.; Rojas, E.; Valenzuela, L.; Zarza, E.; León, J. Analysis of the experimental behavior of a 100 kW_{th} latent storage system for direct steam generation in solar thermal power plants, Applied Thermal Engineering 30 (2010) 2643-2651.

Associated funded project:

- Research Cooperation in Renewable Energy Technologies for Electricity (REELCOOP), 2013-2017, European Commission, 7th FP

**CIEMAT-PSA
(Spain)**



TASK III-TES

Set-ups for PCM testing: HDR, AGH and SUBMA

Challenges:

Testing PCMs in both air (HDR and AGH) and inert atmospheres (SUBMA)

- Under conditions close to service
- Under accelerated conditions in order to assess long term durability

State of the art:

- PCM performance usually evaluated with differential scanning calorimetry (DSC) or T-history techniques.
- Not many studies carried out for PCMs under service or accelerated conditions

HDR:

- Oven *under ambient air* atmosphere
- Accurate control of heating rate.
- Sample temperature monitoring
- Thermal cycles up to 500°C
- Subsequent cycles or cycles with stand-by periods
- Sample size: 10-20 g



AGH:

- Oven *under ambient air* atmosphere
- Accurate control of heating & cooling rates.
- Sample temperature monitoring
- Thermal cycles up to 350°C
- Subsequent cycles or cycles with stand-by periods
- Sample size: 30-40 g
- Adapted for T-history measurements



SUBMA:

- Small closed device inside a furnace
- Tests *under inert atmosphere* (N_2 , Ar)
- Accurate control of heating rate and gas flow
- Sample temperature monitoring
- Thermal cycles up to 500°C
- Subsequent cycles or cycles with stand-by periods
- Sample size: 30-40 g



Further information:

HDR and AGH Contact person: Rocío Bayón (rocio.bayon@ciemat.es)

SUBMA Contact person: Margarita Rodríguez (margarita.rodriguez@psa.es)

- R. Bayón, A. Bonanos, E. Rojas. Assessing the Long-Term Stability of Fatty Acids for Latent Heat Storage by Studying their Thermal Degradation Kinetics. EUROSUN 2020. 3-5 September 2020. Athens (online).
- R. Bayón, E. Rojas. Development of a new methodology for validating thermal storage media: Application to phase change materials. Int. J. Energy Res. 43 (2019) 6521-6541.
- R Bayón, E. Rojas. Feasibility study of D-mannitol as phase change material for thermal storage, AIMS Energy 5 (2017) 404-424
- M.M. Rodríguez-García, R. Bayón, E. Rojas. Stability of D-mannitol upon melting/freezing cycles under controlled inert atmosphere. Energy Procedia 91 (2016) 218-225.

Future work:

- Construction of a new device for tests under inert atmosphere and controlled heating/cooling rates.
- Design of experimental procedures for validating PCMs.
- Study of PCM degradation kinetics: TGA + HDR oven
- Establish a protocol for T-history measurements in the AGH set-up. Construction of a sample holder

**DLR: German
Aerospace Center
(Germany)**



Extended Finned Tubes

Challenges:

- Material synthesis and characterization => mostly nitrate salts and their mixtures
- Low thermal conductivity of phase change materials (PCM) => heat transfer enhancement
- Challenges for heat transfer enhancement => thermal stability, mechanical stability, good contact to heat exchanger pipes
- High grade of volume change during phase change => avoid material stress
- Operation characteristics of storage

State of the art:

- PCM system with embedded heat exchanger using simple fin geometries without optimization of material use

Concept approach:

- Graphite as heat transfer matrix => only applicable below 250 °C and as fin structure, not as expanded matrix.
- Aluminium fin arrangement (radial or longitudinal fins)
 - Vertical tube arrangement feasible
 - Cost effective concept with extruded longitudinal fins

Current R&D status:

- Finned tube design demonstrated with
 - graphite fins / horizontal tube arrangement (<250 °C)
 - Aluminium fins / vertical tube arrangement (<350 °C)
- Experimental validation of PCM storage concept:
 - 5 lab and pilot test modules with 140-2000 kg PCM with 4 salt mixtures
 - Demonstration of a 14 tons NaNO₃ PCM storage (700 kWh, 400 kW, 2949 h, 95 cycles)
- Operation aspects: Discharge modes demonstrated in 100 bar water/steam test-loop:
 - Fixed pressure operation => decrease of heat flux over time
 - Sliding pressure => constant heat flux possible
 - Forced and natural circulation
 - Once-through operation and in all modes possible
 - Very high specific heat flux (400 kW average) demonstrated

Further information:

Contact person: Maïke Johnson (maïke.johnson@dlr.de)

Publications:

- Laing D, Bauer T, Breidenbach N, Hachmann B, Johnson M. Development of High Temperature Phase-Change-Material Storages. Appl Energy. 2013;109(September 2013):497–504.

Current Projects: TESIN and DSG-Store (both BMWi federally funded)

Future work:

- Reduction of cost by industrial fabrication of fin/tube arrangement
- Definition of module size for power plant applications
- Demonstration of several modules in a larger scale (ca. 20-30 MWh)
- Optimization of heat exchanger geometry

**DLR: German
Aerospace Center
(Germany)**



PCMflux CONCEPT

Challenges:

- In PCM systems with heat exchangers embedded into the storage material the power declines during discharging due to increasing layers of solidified storage material covering the heat transfer surfaces
- The capacity of today's PCM storage systems cannot be increased without increasing also the heat exchanger
- The heat exchanger is not accessible for maintenance
- The charge state cannot be measured

State of the art:

Finned tube heat exchangers are embedded into the storage volume. In order to compensate the increasing heat transfer resistance the heat exchanger has to be oversized to ensure a sufficient heat transfer rate during the discharge process. The costs of the system are dominated by the costs of the heat exchanger

Concept approach:

PCMflux is an active PCM storage concept. The storage material is moved across the heat transfer surface, the thermal resistance remains constant. The transferred power can be adjusted by the velocity of the movement. The PCM is transported in open containers, a thin fluid layer between the containers and the heat transfer surface reduces the thermal resistance and the mechanical friction.

Current R&D status:

- experimental research on heat transfer via an intermediate fluid layer
- development of a simulation tool for the PCMflux concept
- feasibility of the PCMflux concept has been proven in lab-scale
- 10 kW test rig under construction

Further information:

Contact person: Wolf-Dieter Steinmann (wolf.steinmann@dlr.de)

Publications:

- Steinmann, W.D. Separation of power and capacity in latent heat energy storage, Energy Procedia 69 (2015) 997-1005
- Steinmann, W.D. 'Speichersystem zur Speicherung thermischer Energie', Patent No. DE 10 2004 020 993 B4 2009

Research project: NextPCM funded by the German Federal Ministry for Economic Affairs and Energy

Future work:

- Assessment of alternative geometry options
- Application of various PCMs

ENEA
(Italy)

ENEA
Agenzia nazionale per le nuove tecnologie,
l'energia e lo sviluppo economico sostenibile



TASK III-TES

Latent Heat Storage with Phase Change Materials and Nanoparticles

Challenges:

- Study and development of Heat Storage Materials with high energy density to reduce the storage volume and associated cost
- Enhancement of the thermal diffusivity/conductivity of the common PCMs (i.e. nitrate salts and their mixtures) to increase the thermal storage efficiency (Nano Enhanced PCMs)
- Improve HTF-PCM heat transfer mechanisms in latent heat thermal storage systems in order to make them more efficient

State of the art:


- PCMs (i.e. nitrate salts and their mixtures) as thermal storage media => low thermal conductivity
- PCMs with dispersed nanoparticles can increase thermal capacity and conductivity => verified only for low temperatures (<200°C)

Concept approach:


- Latent Heat Thermal Energy Storage using PCMs and nanoparticles:
 - ✓ high storage energy density (heat capacity)
 - ✓ high thermal diffusivity
 - ✓ low TES volume
 - ✓ low TES cost

Current R&D status:

- Various combinations of molten salt mixtures and nanoparticles have been analyzed for melting temperatures between 150°C and 600°C.
- Enhancements of heat capacity for a phase change storage material composed of Solar Salts and $\text{SiO}_2\text{-Al}_2\text{O}_3$ nanoparticles and KNO_3 and SiO_2 nanoparticles and has been verified.
- Enhancements of thermal conductivity and diffusivity for a phase change storage material composed Solar Salts and metallic nanoparticles or CNTs have been verified.
- Various mixing protocols have been analyzed and applied to study their effect on the final result.
- An experimental analysis of heat transfer in elementary "shell-and-tube" LHTES using solar salts as PCM and/or NEPCM has been conducted by realizing a facility named ATES.
- Complex and simplified numerical analyses to characterize the heat exchange mechanisms

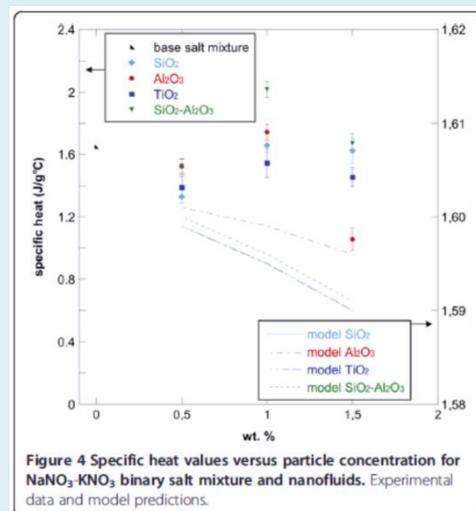


by

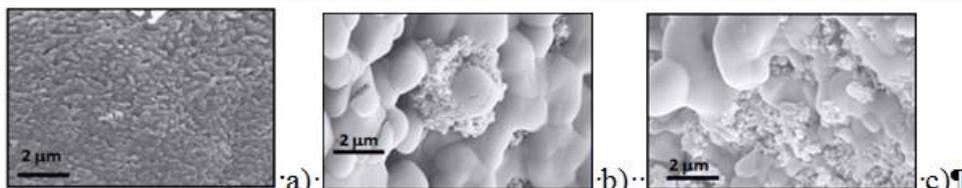

SEM images of the solar salts with: a) base b) +1% $\text{SiO}_2\text{-Al}_2\text{O}_3$ c) +1% $\text{SiO}_2\text{-Al}_2\text{O}_3$



ATES Facility

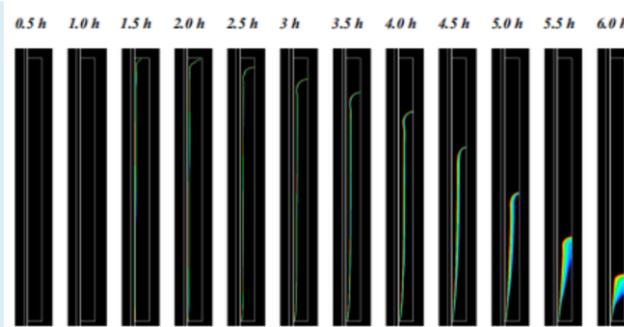

Position of the melting front

Further information:

- Contact person: Dr. Adio Miliozzi, adio.miliozzi@enea.it
- Publications:
 - F. Fornarelli, S.M. Camporeale, B. Fortunato, M. Torresi, P. Oresta, L. Magliocchetti, A. Miliozzi, G. Santo, "CFD analysis of melting process in a shell-and-tube latent heat storage for concentrated solar power plants", *Applied Energy* 164 (2016) 711–722 (ISSN: 0306-2619)
 - F. Fornarelli, V. Ceglie, B. Fortunato, M. Torresi, P. Oresta, A. Miliozzi, S.M. Camporeale, Numerical simulation of a complete charging-discharging phase of a shell and tube thermal energy storage with phase change material, *Energy Procedia* 126 (2017) 501–508, ISSN: 1876-6102
 - M. Chieruzzi, G.F. Cerritelli, A. Miliozzi, J.M. Kenny, L. Torre, Heat capacity of nanofluids for solar energy storage produced by dispersing oxide nanoparticles in nitrate salt mixture directly at high temperature. *Solar Energy Materials and Solar Cells*, Volume 167, August 2017, Pages 60-69 ISSN: 0927-0248
 - M. Chieruzzi, A. Miliozzi, T. Crescenzi, J.M. Kenny, L. Torre, Synthesis and Characterization of Nanofluids Useful in Concentrated Solar Power Plants Produced by New Mixing Methodologies for Large-Scale Production, *J. Heat Transfer* 140(4), 042401 (Jan 10, 2018) (13 pages), paper No: HT-17-1053; doi: 10.1115/1.4038415; ISSN:0022-1481
 - G. Mazzucco, G. Xotta, V.A. Salomoni, C.E. Majorana, G.M. Giannuzzi, A. Miliozzi, Modelling techniques of storage modules with PCM micro-capsules, *Journal of Energy Engineering*, 144(1):05017005, 2018, ISSN: 0733-9402
 - A. Miliozzi, M. Chieruzzi, L. Torre, Experimental investigation of a cementitious heat storage medium incorporating a solar salt/diatomite composite phase change material, *Applied Energy* 250 (2019) 1023–1035, ISSN: 0306-2619
- Associated funded projects:
 - National program funded by the Italian Ministry for Economic Development (MISE): "Piano Triennale Ricerca di Sistema 2019-2021"

Future work:

- Synthesis of a molten salt and nanoparticle mixture with lower melting temperature (about 150°C): choice of the components (nanoparticles, CNTs, etc.) and the mixing protocol
- Realization of an experimental facility (ATES upgrading) able to execute thermal energy charge-discharge tests in a small optimized and modular LHTES.
- Development of a numerical model useful for LHTES evaluation and design.

Fraunhofer ISE
(Germany)



TASK III-TES

Latent heat storage with screw heat exchanger

Challenges:

- Development of active latent heat exchanger using a screw heat exchanger: allow transport of PCM during melting and crystallization
- Conduct melting and crystallization of PCM inside screw heat exchanger
- Achieve high thermal powers inside screw heat exchanger
- Development of concept for high pressure steam inside screw heat exchanger

State of the art:

- Passive latent heat storages with embedded heat exchangers (One tank solution). Disadvantages: Decreasing thermal power during storage discharge, capacity and thermal power are coupled directly
- Encapsulated PCM for low temperature applications

Concept approach:

- Transport of solid PCM with transport screws
- Pumping of liquid PCM
- Melting and crystallization of PCM inside screw heat exchanger
- Use of heat pipes for a high pressure concept

Advantages:

- Constant thermal power during storage discharge possible
- Thermal power and storage capacity decoupled
- Advantageous for large thermal capacities
- PCM easily interchangeable

Disadvantages:

- Moving parts (high maintenance effort)
- Measurement of properties of PCM (needed for control of system) in slurry state complicated
- High(er) heat losses compared to passive storage due to larger surfaces

Current R&D status:

- Operational strategies for melting and crystallization developed
- Heat transfer coefficients on PCM side determined for $\text{NaNO}_3/\text{KNO}_3$
- Development of high pressure concept using heat pipes inside flights ongoing
- Automation of screw heat exchanger ongoing

Further information:

Contact person: Verena Zipf (Verena.Zipf@ise.fraunhofer.de)

Publications:

- V. Zipf, D. Willert, A. Neuhäuser: Active Latent Heat Storage with a Screw Heat Exchanger – Experimental Results for Heat Transfer and Concept for High Pressure Steam. SolarPaces - Concentrating solar power and chemical energy systems, Capetown, South Africa, 2015.

IEE-CAS
(China)



Phase change material thermal energy storage

Challenges:

- Improving the thermal conductivity of phase change materials.
- Mushy zone between liquid and solid phases.
- Increasing the heat transfer of phase change materials by process controlling.

State of the art:

There are many publications on mushy zone by simulation. Few studies are focusing on the evolution of phase change during charging and discharging process by experimental method.

Concept approach:

- **Advantages:**
 - Large energy storage density.
 - Reduced cost of thermal storage system.
 - Small working temperature range.
- **Disadvantages:**
 - Heat transfer, liquid flow and phase change are related with the solid microstructure and mushy zone.

Current R&D status:

- The microstructural evolution and related heat & mass transport mechanisms within the mushy zone during solid-liquid phase transitions are studied from three different scales, i.e. macro-, micro-, and mesoscale.

Further information:

Contact person: yangbei0127@163.com

Publications:

- Yang, B., Raza, A., Bai, F., Zhang, T. & Wang, Z. (2019). Microstructural evolution within mushy zone during paraffin's melting and solidification. *International Journal of Heat and Mass Transfer*. 141, 769–778.
- Yang, B. & Wang, Z., Image-based Modelling for Fluid Flow and Permeability Prediction within Continuously-Evolving Mushy Zone during Melting and Solidification. *International Journal of Heat and Mass Transfer*, 147: 119000.
- Yang, B., Bai, F., Wang, Y., & Wang, Z. (2020). How mushy zone evolves and affects the thermal behaviors in latent heat storage and recovery: A numerical study [J]. *International Journal of Energy Research*. 1-19.

Future work:

- Study the physical characteristics and evolution law of mushy area.

IEE-CAS
(China)



TASK III-TES

Phase change thermal energy storage with bioinspired structure

Challenges:

- High thermal conductivity of phase change material, especially in discharging process.
- Bioinspired flow structure, including the bioinspired system, design theory, control method.
- The phase change character within the bioinspired structure region during melting and solidification.

State of the art:

- Few CSP plant is adapted phase change TES.
- PCM technology is still pilot scale in high temperature.
- No publication indicated that bioinspired technology has used in phase change thermal storage system.

Concept approach:

- **Advantages:**
 - Capillary force enhances flow and heat transfer between HTF and phase change media.
 - Increase the intercostal efficiency of heat transfer surface between HTF and phase change media.
- **Disadvantages:**
 - Pressure drop in micro-channel, distribution.
 - Continuous circulation channel: design, control, and flow pattern.

Current R&D status:

- Biological system had investigated and selected the bioinspired objector.
- Some experiments of flow and heat transfer in bioinspired phase change TES had been done.

Further information:

Contact person: wangyan955@126.com

Future work:

- Investigate the characters of heat transfer and flow both simulation and experimental.

Green Energy Park – IRESEN (Morocco)



TASK III-TES

Heat transfer enhancement for LHTES

Challenges:

- Achieving high density storage systems with stable supply temperatures.
- Improving solid/liquid heat transfer with enhanced low-cost encapsulation.
- Increasing conductivity and of molten salts as PCM with additives and nanoparticles.

State of the art:

- Various finned tubes configurations on the literature with significant cost reductions.
- Spherical/pebble encapsulation considered with multiple encapsulant materials.
- Finned tubes pilot scale systems tested, and performance validated.

Concept approach: (mentioning advantages & disadvantages)

- Enhancing HTF-PCM heat transfer with improved encapsulation architecture.
- Enhancing PCM-PCM heat transfer with molten salts additives
- Advantages
 - Improved heat transfer and reduced material usage for encapsulation.
 - Higher storage density and lower CAPEX for storage tank end equipments.
 - Reduced cost per kWh of Latent Heat TES.
- Challenges
 - Limitation of improvement possibilities beyond encapsulant material capabilities.
 - Performance-cost conflict for encapsulant materials.
 - Experimental data on additives impact on PCM performance.

Current R&D status:

- Molten salt with additives and encapsulants preparation and characterization.
- Modelling and design of various finned tube architectures for PCM storage.
- Preparation of a small-scale modular prototype for fins and salt mixtures validation.

Further information:

Contact person : Zakaria ELMAAZOUZI (elmaazouzi@iresen.org)/ Reda BOUALOU (boualou@iresen.org)

Publications:

- Elmaazouzi, Z., Alami, M. E., Agalit, H., Bennouna, E. G., & Ydrissi, M. E. (2019, July). A comparative analysis of the performance of LHTES systems-case study: Cylindrical exchanger with and without annular fins. In AIP Conference Proceedings (Vol. 2123, No. 1, p. 020073). AIP Publishing LLC.
- Elmaazouzi, Z., El Alami, M., Agalit, H., & Bennouna, E. G. (2020). Performance evaluation of latent heat TES system-case study: Dimensions improvements of annular fins exchanger. Energy Reports, 6, 294-301.

Future work:

- Performance assessment of various fins configurations with CFD tools and small-scale prototype test.
- Continue characterization of possible additives/nano-powders for molten salts enhancement, and possible encapsulants.

**SUPSI, ETHZ
ALACAES
(Switzerland)**

University of Applied Sciences and Arts
of Southern Switzerland

SUPSI



TASK III-TES

Single-tank TES system – Stabilization of HTF outflow temperature during discharging

Challenges:

- Single-tank TES systems have the inherent disadvantage of a decreased HTF outflow temperature towards the end of discharging => HTF temperature stabilization required.
- The solution proposed has to be suitable for high-temperature applications (up to 650°C).
- Experimental and numerical investigation on the combined sensible/latent heat TES.

State of the art:


Single-tank TES systems, with a packed bed of low cost filler material, represent an efficient and cost effective solution for storing thermal energy. However, an inherent disadvantage of the sensible heat storage is the drop of the outflow air temperature toward the end of discharge period leading to a non-optimal working condition of the power block.

Concept approach:

- The combined sensible/latent heat TES concept is proposed: a small layer of PCM is added at the top of the packed bed with the aim of stabilizing the HTF outflow temperature during discharging keeping almost unchanged the overall TES cost.


Current R&D status:

- A 42.4 kWh_{th} lab-scale combined TES consisting of a packed bed of rocks and steel-encapsulated AlSi₁₂ has been built and tested.

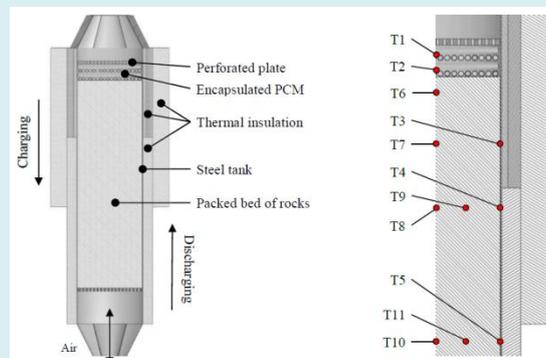


Schematic of the lab-scale combined TES prototype.

- Two numerical modeling strategies has been followed to study the behavior of the combined sensible/latent heat TES: (i) a 1D heat transfer model, suitable for parametric studies thanks to the low computational cost required, and (ii) a 2D computational fluid dynamics (CFD) model, more accurate especially in the case of low vessel-to-particle diameter ratio (as in the experimental prototype) but computationally more expensive.

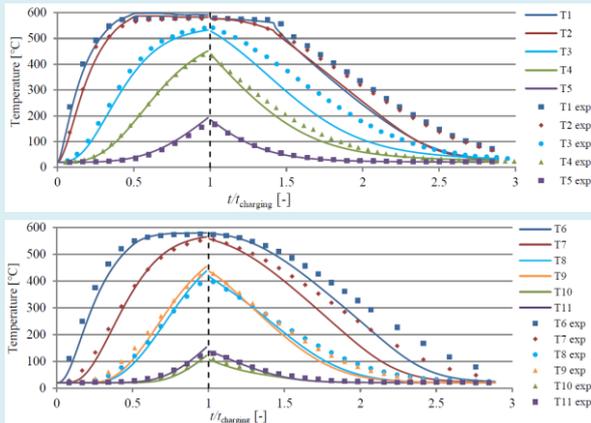

CFD simulation results (solid lines) VS experimental data (markers); top: PCM and tank wall temperatures, bottom: packed bed.

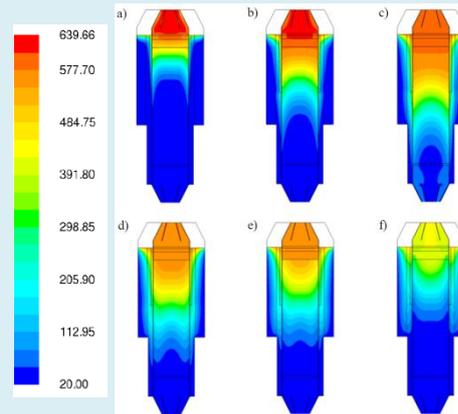

Temperature contours during charge: a) 1.15 h; b) 2.25 h; c) 3.25 h and discharge: d) 0.55 h; e) 1.15 h; f) 2.25 h.

Further information:

Contact person: Mr. Simone Zavattoni (simone.zavattoni@supsi.ch)

Publications:

- S.A. Zavattoni, L. Geissbühler, M.C. Barbato, G. Zanganeh, A. Haselbacher, A. Steinfeld, "High-temperature thermocline TES combining sensible and latent heat - CFD modeling and experimental validation", AIP Conference Proceedings 1850, 080028, 2017.
- L. Geissbühler, S. Zavattoni, M. Barbato, G. Zanganeh, A. Haselbacher, A. Steinfeld, "Experimental and Numerical Investigation of Combined Sensible/Latent Thermal Energy Storage for High-Temperature Applications", CHIMIA, 69 (12), 799-803, 2015.

Future work:

Optimizing the amount of PCM at the top of the packed bed.

UniZar-I3A
(Spain)



TASK III-TES

THERMAL STORAGE

Challenges:

- Determination of thermophysical and rheological properties of TES materials.
- Lowering the price of TES systems.
- Obtaining recommendations about the most appropriate TES technologies to develop.
- Integration of TES in DHC systems to take advantage of renewable energy resources, residual heat or thermal sources more favorable.
- Use of low cost phase change material emulsions as heat transfer fluids

State of the art:

- Lack of standardized methodologies to characterize TES materials.
- Material cost is critical in some applications.

Concept approach:

- Participation in RRT in the framework of Task 42-Annex 29-IEA-SHC-ECES “Compact Thermal Energy Storage” to develop procedures to characterize TES materials: $h(T)$; $\lambda(T)$; $\rho(T)$; $\mu(T)$
- Search of low cost and low environmental impact materials to be used as TES materials.
- Accurate comparison of TES systems from the determination of their KPI (such as energy density, heat transfer rate, acceptable maximum heat losses...).
- Integration of a decentralized TES with a low cost PCM emulsion to curtail the peak demand, and to enable the connection of additional buildings in a saturated DH.

Current R&D status:

- Participation in RRT to develop standardized methodologies to characterize TES materials. Coordination of the viscosity measurements.
- Experimental study of a TES system with a low cost PCM emulsion. Different measures are being adopted to improve heat transfer performance. Assessment of KPI for its comparison.
- Commissioning and verification of a T-history installation of high temperature to evaluate enthalpy-temperature curves up to 300°C.

Further information:

Contact persons: Ana Lázaro (ana.lazaro@unizar.es) and Mónica Delgado (monica@unizar.es)

Publications:

- Lázaro A., Peñalosa C., Solé A., Diarce G., Haussmann T., Fois M., Zalba B., Gschwander S., Cabeza L.F.: Intercomparative tests on phase change materials characterisation with differential scanning calorimeter. *Appl Energy* 109 (2013) 416-420.
- Delgado M., Gschwander S., Lázaro A., Peñalosa C., Zalba B.: Determining the rheological behavior of octadecane as phase change material: First approach. *Thermochim Acta* 648 (2012) 81-87.
- Mazo J., Delgado M., Lázaro A., Dolado P., Peñalosa C., Marín J.M., Zalba B.: A theoretical study on the accuracy of the T-history method for enthalpy-temperature curve measurement: Analysis of the influence of thermal gradients inside T-history samples. *Meas Sci Technol* 26 (12) (2015)
- Delgado M., Lázaro A., Mazo J., Peñalosa C., Dolado P., Zalba B.: Experimental analysis of a low cost phase change material emulsion for its use as thermal storage system. *Energy Conversion and Management* 106 (2015) 201-212.
- Guadalajara M., Lozano M.A., Serra L.M.: Simple calculation tool for central solar heating plants with seasonal storage. *Solar Energy* 120 (2015) 72-86.

Website: Laboratory of characterization of thermophysical and rheological properties

http://i3a.unizar.es/sites/default/files/documentos/laboratorio_ingenieria_termica_GITSE.pdf

THERMOCHEMICAL STORAGE

CEA – LITEN
(France)



TASK III-TES

Thermochemical Heat Storage for CSP

Challenges:

- Cycling and lifetime of the storage media,
- Continuous operation of the storage process,
- Discharging temperature at the same level as charging temperature,
- Demonstration of feasibility at prototype scale and realistic conditions.

State of the art:

- High temperature thermochemical storage is currently at the laboratory scale.
- Solids/Gas reaction of $\text{CaO} + \text{H}_2\text{O} \leftrightarrow \text{Ca(OH)}_2$

Concept approach:

Daily and seasonal heat storage using the reversible reaction $\text{CaO} + \text{H}_2\text{O} \leftrightarrow \text{Ca(OH)}_2$:

- Non or slightly pressurized bubbling or circulating Fluidized bed reactor.
- Non expansive natural lime as storage material.
- Doping of the materials to improve mechanical and chemical properties;
- Study of the chemical and/or mechanical performances degradation of the storage material. Attrition, sintering, thermal breakage of the solid particles.

Current R&D status:

- A batch bubbling fluidized bed at room temperature and atmospheric pressure for fluidization characterization (pressure drop, minimal velocity of fluidization and transport, attrition, particles cohesion)
- A batch bubbling fluidized bed at high temperature and atmospheric pressure for thermochemical characterizations:
 - 5 kW (2-3 kg solid), ≤ 1 m/s, up to 500 °C, $\leq 75\% P_{\text{steam}}$
- A continuous bubbling fluidized bed at high temperature and atmospheric pressure
 - 5 kW reaction / 15 kWh (20 kg/h solid), ≤ 2 m/s, $\leq 600^\circ\text{C}$, $\leq 100\% P_{\text{steam}}$
- A 1D numerical model of a batch bubbling fluidized bed reactor coupling thermal, chemical and hydrodynamic laws has been developed

Further information:

Contact person: Sylvie Rougé (sylvie.rouge@cea.fr)

Publications:

- P. Pardo, A. Deydier, Z. Anxionnaz-Minvielle, S. Rougé, M. Cabassud, P. Cognet. A review on high temperature thermochemical heat energy storage. Renewable And Sustainable Energy Reviews Volume: 32 Issue: 2 (2014) p. 591-610.
- Pardo, P.; Anxionnaz-Minvielle, Z.; Rougé, S.; Cognet, P.; Cabassud, M. $\text{Ca(OH)}_2/\text{CaO}$ reversible reaction in a fluidized bed reactor for thermochemical heat storage. Sol. Energy 2014, 107, 605.
- Y.A. Criado, M. Alonso, J.C. Abanades, Z. Anxionnaz-Minvielle; Conceptual process design of a $\text{CaO}/\text{Ca(OH)}_2$ thermochemical energy storage system using fluidized bed reactors; Applied Thermal Engineering, 73, 1085–1092 (2014).
- Y.A. Criado, A.Huille, S. Rougé, J.C. Abanades; Experimental investigation and model validation of the $\text{CaO}/\text{Ca(OH)}_2$ fluidized bed reactors for thermochemical energy storage applications, Chemical Engineering Journal 313 (2017) 1194-1205.
- Rougé, S.; Criado, Y.A. ; Soriano, O.; Abanades, J.C. Continuous $\text{CaO}/\text{Ca(OH)}_2$ fluidized bed reactor for energy storage: first experimental results and reactor model validation. Industrial & Engineering Chemistry Research 56 (4), pp. 844-852 (2017).

Future work:

- Doped materials will be tested in steady state operation with the continuous bubbling fluidized bed.

**DLR: German
Aerospace Center
(Germany)**



THERMOCHEMICAL ENERGY STORAGE WITH $\text{Ca}(\text{OH})_2$

Challenges:

Material:

- Low cost material that is already available in large industrial scale but so far not used for thermal energy related applications. Main challenges are the morphological changes within the bulk during the reaction as well as the in general very small particle diameter.

Reactor:

- Heat transfer from reactive powder to the HTF / Reaction gas supply and distribution
- Volume change during chemical reaction

Integration:

- Equilibrium temperature of the chemical reaction
- Storage and supply of reaction gas

State of the art:

- 10 kW / 10 kWh system for $\text{Ca}(\text{OH})_2$ in operation since 2013
- 10 kW / 100 kWh system for $\text{Ca}(\text{OH})_2$ with a moving bed operated first time in 07/ 2015

Concept approach:

- The main idea is the detachment of the simple storage from the reaction zone that is due to above mentioned challenges in general more complex.
- Based on this clear separation, it is possible to store thermal energy at ambient conditions
- One main challenge is the adjustment of proper reaction conditions in moving material

Current R&D status:

- Experimental set-up available in 100 kWh scale. Current work focuses on continuous operation and optimization of secondary components.
- Reduction of reactor complexity along with an increase of powder density
- System integration of water vapor
- Material modification in order to facilitate the heat exchange btw. HTF and reacting powder

Further information:

Contact persons: Marc Linder (marc.linder@dlr.de) and Matthias Schmidt (matthias.schmidt@dlr.de)

Website: https://www.dlr.de/tt/en/desktopdefault.aspx/tabid-11483/7874_read-12367/

Publications:

- Schmidt et al., (2013) Experimental results of a 10 kW high temperature thermochemical storage reactor based on calcium hydroxide. Applied Thermal Engineering (62), 553-559. DOI: <http://dx.doi.org/10.1016/j.applthermaleng.2013.09.020>
- Linder et al. (2014) Thermochemical Energy Storage in kW-scale based on $\text{CaO}/\text{Ca}(\text{OH})_2$. Energy Procedia (49), 888-897. Elsevier. DOI: 10.1016/j.egypro.2014.03.096

Future work:

- Continue with the detachment of power and capacity by transport of the reaction material from a simple storage through the complex reaction zone (reactor). Take potential material modifications into account. Integration aspects, e.g. into CSP plants. Take advantage of chemical reaction - re-think CSP for thermochemical storages.

ENEA
(Italy)

ENEA
Agenzia nazionale per le nuove tecnologie,
l'energia e lo sviluppo economico sostenibile



TASK III-TES

Chemical heat storage by reversible chemical reactions

Challenges:

- Assessment of a compact heat storage system, reliable and efficient, especially designed to be used for seasonal heat storage
- Testing and validation of thermochemical storage units directly powered by concentrated solar thermal plant.

State of the art:

- Even if the analysis of possible thermochemical storage systems started in the 1970s (sulfates, calcium carbonate or hydroxide, ammonia, cobalt oxide, manganese oxide, etc), only recently have thermochemical reactions been reconsidered for the purpose of high temperature heat storage.
- The development of these storage systems is still at an early stage because of material degradation and complex technology
- The analysis is currently focused on the cycling behavior (reversibility and degradation over large numbers of cycles) and kinetics of charging and discharging steps.



Concept approach:

- The attention was focused on the following reversible reactions, even considering synthetic materials capable of standing continuous and repeated cycles:
 - $\text{CaO} + \text{CO}_2 \rightarrow \text{CaCO}_3$ (to be integrated with central tower plants)
 - $\text{CaO} + \text{H}_2\text{O} \rightarrow \text{Ca(OH)}_2$ (to be integrated with parabolic trough plants)
 - $\text{MO}_{(x-\delta)} + (\delta/2) \text{O}_2 \rightleftharpoons \text{MO}_x$ (to be integrated with central tower plants)
- Besides the experimental activity, focused on the chemical and physical characterization of synthetic materials, a theoretical analysis aimed at the definition of suitable process schemes for the solar plants-TCS integration, with the design of the coupling interfaces (heat exchangers, direct contact reactors, adiabatic reactors), was performed
- Both open and closed cycles were analyzed, considering also the hypothesis of charging and discharging facilities located in different places.

Current R&D status:

Validation and collection of thermo-physical properties concerning the CaO/Ca(OH)₂ system;

- Kinetic characterization of the carbonates and mixed oxides reacting systems (charging and discharging steps);
- Modelling of a reactor module for the analysis of the charging and discharging steps dynamics;
- Design of possible process schemes for the integration of thermochemical storage with the central tower technology (calcium carbonate) and the parabolic trough technology (calcium hydroxide), with the definition of the operating parameters in nominal conditions

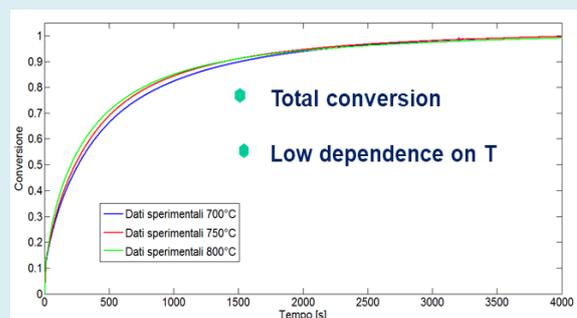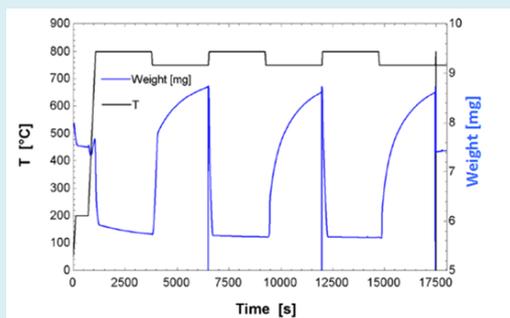

CaO on mayenite: a) TGA test (calcination at 800°C, carbonation at 750 °C); b) Conversion of the carbonation reaction over time

Further information:

Contact person: Michela Lanchi PhD, ENEA DTE-STSN; michela.lanchi@enea.it

Publications:

- S. Sau, N. Corsaro, M. Lanchi, R. Liberatore, L. Turchetti, F. Varsano, M.C. Annesini, Experimental characterization of mayenite supported CaO for thermochemical storage of solar energy, Proceedings SolarPACES 2018, October 2-5, Casablanca, Morocco

Associated Funded Projects:

- STAGE-STE (Scientific and Technological Alliance for Guaranteeing the European Excellence in Concentrating Solar Thermal Energy).
- National program funded by the Italian Ministry for Economic Development (MISE): “Piano Triennale Ricerca di Sistema 2019-2021”

Future work:

- Realization of a pressurized circuit, provided with gas/solid reactor, to test the carbonates and oxides systems under realistic experimental conditions
- Exhaustive experimental campaign to test reactivity and stability of different carbonates and oxides formulations under realistic experimental conditions
- Dynamic analysis of the TCS unit
- Techno-economic evaluation of the TCS unit

**INSTITUTION:
ICP-CSIC**



Perovskites for Thermochemical Heat Storage

Challenges:

Boost in efficiency of CSP plants is mostly driven by operating at higher temperatures, up to 1200 °C. Such high temperatures lead to new challenges in terms of cost-effective materials and components development. This makes a compelling case for investigating high temperature (≥ 800 °C) heat storage systems.

State of the art:

Up to now, few materials have been investigated for high temperature (800-1200 °C) heat storage. CaMnO_3 oxide has been addressed as a promising candidate.

Concept approach:

The overall objective of this project is to study perovskites with more earth abundant elements (i.e. Ca, Fe, Mn-based) for identifying the most promising candidate storage materials on which it is carried out a comprehensive thermodynamic study that enables the evaluation of their heat storage capacity.

Advantages:

- The temperature for storing heat in perovskites is higher and the window for temperature storage is broader in comparison to the most promising stoichiometric redox systems reported in literature to date (i.e. $\text{Co}_3\text{O}_4/\text{CoO}$, $\text{Mn}_2\text{O}_3/\text{Mn}_3\text{O}_4$ redox pairs).
- Reduction reaction is fully reversible, hence no energy loss due to un-reoxidized material
- Thermodynamic properties can be tuned by A- or B-site doping.

Limitation:

- CaMnO_3 undergoes decomposition at $p\text{O}_2 \leq 0.008$ atm and temperature ≥ 1100 °C.
- Cost-effective and earth-abundant compositions are necessary to reduce the economic impact of the material.

Current R&D status:

- Several $(\text{La}_x\text{Ca}_{1-x})(\text{Fe}_y\text{Mn}_{1-y})\text{O}_3$ have been synthesized, characterized and their unknown thermodynamic properties evaluated by first time. This activity has been developed at Northwestern University.
- Based on the thermodynamic consideration, the most promising candidate material has been identified and its synthesis has been scaled-up for laboratory scale reactor tests. This activity has been developed at the ICP-CSIC laboratories.

Further information: (contact person, *most relevant papers in journals & conferences, web pages, associated funded project*)

Contact persons: jm.coronado@csic.es; e.mastronardo@csic.es

Web page: <http://sesperproject.blogspot.com/p/project-description.html>

- Mastronardo, E., Qian, X., Coronado, J.M., Haile, S.M. The favourable thermodynamic properties of Fe-doped CaMnO_3 for thermochemical heat storage. *Journal of Materials Chemistry A*, 2020, 8(17), pp. 8503-8517. DOI: 10.1039/d0ta02031a
- Mastronardo, E., Qian, X., Coronado, J.M., Haile, S.M. Fe-doped CaMnO_3 for thermochemical heat storage application. *AIP Conference Proceedings*, 2019, 2126,210005. DOI: 10.1063/1.5117754

Associated funded project: SESPer-Solar Energy Storage Perovskites Marie Skłodowska-Curie Individual Global Fellowship. This project has received funding from the European Union's Horizon 2020 research and innovation programme under the Marie Skłodowska-Curie grant agreement N° 74616. These activities are also partially by Project ACES2030(P2018/EMT-4319) from "Comunidad de Madrid" and European Structural Funds.

Future work:

Laboratory-scale reactor test are on-going in collaboration with IMDEA Energy Institute.

**TAU: Tel Aviv
University
(Israel)**



Thermo-electro-chemical storage (TECS) of solar energy

Challenges:

Solar thermal electricity generation with storage is not yet competitive, and its conversion efficiency is relatively low for the leading technologies.

State of the art:

CSP plants rely on a thermo-mechanical conversion with steam Rankine cycle; thermal storage relies on two tanks of molten salt with heat exchange to the steam cycle, and in some cases additional heat exchange to the solar field HTF. Alternative cycles (e.g. CO₂ or air Brayton cycle) and alternative storage methods (PCM or chemical storage cycles) are under development and not yet available.

Concept approach:

The proposed approach is to eliminate the thermo-mechanical cycle and replace it with thermally driven electro-chemical conversion. The TECS cycle contains a high temperature solar reactor driven by a CSP concentrator (dish or heliostat field) for charging, storage tanks for charged and discharged components, and an electrochemical cell for discharging (electricity generation). Potential advantages include: power generation without complex heat engines, avoiding multiple fluid loops, and potentially high conversion efficiency.

Current R&D status:

A preliminary thermodynamic analysis including several candidate materials has shown that the theoretical conversion efficiency of the TECS cycle can be very high. A paper on the analysis is in preparation.

Further information:

Contact persons:

- Prof. Avi Kribus, Tel Aviv University (kribus@tauex.tau.ac.il)
- Michael Epstein (mikiepstein@gmail.com)

Future work:

- Future work includes: analysis with more detailed and realistic cycle design; investigation of additional candidate materials; and experimental validation of the thermo-chemical charging reaction. Following these steps, a lab scale demo of a full cycle should be considered.